

DESIGN & MATERIAL CRITERIA:

THE ADDITION IS DESIGNED IN ACCORDANCE WITH CHAPTER 9 OF THE 2017 FLORIDA BUILDING CODE, 6TH ED. CODE: RESIDENTIAL, CHAPTER 16 OF THE 2017 FLORIDA BUILDING CODE: BUILDING, 2014 FLORIDA BUILDING CODE: EXISTING BUILDING, & AMERICAN NATIONAL STANDARD ASCE 7-10.

TO THE BEST OF THE DESIGNER'S AND/OR ENGINEER'S KNOWLEDGE, THE PLANS AND SPECIFICATIONS COMPLY WITH THE APPLICABLE MINIMUM BUILDING CODES AND THE APPLICABLE FIRE SAFETY STANDARDS AS DETERMINED BY THE LOCAL AUTHORITY IN ACCORDANCE WITH CHAPTER 693 - BUILDING CONSTRUCTIONS STANDARDS, AND CHAPTER 633 - FIRE PREVENTION AND CONTROL, OF THE 2009 FLORIDA STATUTES AND 2009 SUPPLEMENT.

WARNING:

THE STRUCTURAL INTEGRITY OF THE BUILDING SHOWN ON THESE PLANS IS DEPENDENT UPON COMPLETION ACCORDING TO THE PLANS AND SPECIFICATIONS. STRUCTURAL MEMBERS ARE NOT SELF-SUPPORTING DURING CONSTRUCTION AND REQUIRE TEMPORARY BRACING UNTIL PERMANENTLY AFFIXED TO STRUCTURE AS DIRECTED. THE STRUCTURAL ENGINEERS ASSUME NO LIABILITY FOR THE STRUCTURE DURING CONSTRUCTION, UNLESS THE CONSTRUCTION METHOD AND BRACING ARE INCLUDED IN THE PLANS AND SPECIFICATIONS, OR ARE SUPERVISED BY THE STRUCTURAL ENGINEER DURING CONSTRUCTION.

GENERAL NOTES:

- GENERAL CONTRACTOR TO VERIFY ALL CONDITIONS AND DIMENSIONS IN FIELD. IF CONDITIONS DIFFER FROM THAT REPRESENTED IN THESE DRAWINGS, GENERAL CONTRACTOR MUST NOTIFY THE DESIGNER &/OR ENGINEER PRIOR PERFORMING ANY PROPOSED ALTERATIONS, TO PROVIDE CORRECTIVE DETAILS.
- GENERAL CONTRACTOR SHALL VERIFY LOCATION OF EXISTING PLUMBING OR MECHANICAL LINES BEFORE CASTING FOUNDATIONS, OR CAST PROTECTION AROUND LINES AS REQUIRED.
- ALL FILL UNDER FOUNDATIONS SHALL BE COMPACTED MIN. TO 95% OF MAXIMUM DENSITY (MODIFIED PROCTOR TEST) AT OPTIMUM MOISTURE CONTENT.
- PLUMBING CONTRACTOR TO VERIFY SIZE AND CAPACITY OF EXISTING SERVICE. ALL WORK TO BE IN STRICT COMPLIANCE WITH LOCAL CODE.
- MECHANICAL CONTRACTOR TO VERIFY SIZE AND CAPACITY OF EXISTING A.C. SYSTEM IF IT IS TO BE EXTENDED. NEW DUCTWORK TO BE 1" R-D MIN. ALL WORK TO BE IN STRICT COMPLIANCE WITH MIN. ASHRAE AND LOCAL CODE.

BUILDING DATA:

OCCUPANCY CLASSIFICATION: R - RESIDENTIAL
 CONSTRUCTION TYPE: V-5
 ALTERATION LEVEL: 2 - EXTENSION OF EXISTING SYSTEMS.
 (STRUCTURAL ADDITIONS OR ALTERATIONS PROPOSED DO NOT EXCEED 50% OF THE AGGREGATE AREA OF THE EXISTING BUILDING)
 STRUCTURE IS NOT LOCATED IN A SPECIAL FLOOD HAZARD AREA.

DESIGN LOADS:

ROOF DEAD LOAD: 24 PSF
 ROOF LIVE LOAD: 20 psf
 FLOOR LIVE LOAD: LIVING AREAS 40 PSF + 10 PSF PARTITIONS
 SLEEPING AREAS 30 PSF + 10 PSF PARTITIONS
 EXTERIOR DECK: 40 PSF

WIND LOAD BASIS: 146 MPH V₁₀ / 113 MPH V₃₀
 WIND IMPORTANCE FACTOR: I_w = 1.00 RISK CATEGORY: 'II'
 WIND EXPOSURE: 'B' HEIGHT & EXPOSURE COEFFICIENT = 1.00
 INTERNAL PRESSURE COEFFICIENT PER ASCE 7-10 G_{Cp} = +/- 0
 WINDOWS, DOORS & ROOFING DESIGN WIND PRESSURES PER TABLE.
 EDGE DISTANCE: 3: 4'-0"

FOUNDATION DESIGN BASIS:

THE PROPERTY IS NOT LOCATED WITHIN A FLOOD ZONE. CONTINUOUS STRIP FOOTINGS AND/OR SPREAD FOOTINGS ARE DESIGNED WITH AN ALLOWABLE SOIL BEARING PRESSURE OF 2,000 psf. A QUALIFIED TESTING LABORATORY SHALL BE RETAINED BY THE CONTRACTOR TO PERFORM WHATEVER SUBGRADE TESTING THAT IS NECESSARY TO CONFIRM THE ASSUMED BEARING CAPACITY WITHOUT EXCESSIVE SETTLEMENT. IF SOIL OF THIS CAPACITY IS NOT AVAILABLE, NOTIFY THE DESIGNER &/OR ENGINEER FOR CORRECTIVE DETAILS. THERE IS NO WARRANTY OF SOIL CONDITIONS BY THE DESIGNER &/OR ENGINEER.

TERMITE NOTES:

- A WEATHER RESISTANT JOB SITE POSTING BOARD SHALL BE PROVIDED TO RECEIVE DUPLICATE TREATMENT CERTIFICATES AS EACH REQUIRED PROTECTIVE TREATMENT IS COMPLETED, PROVIDING A COPY FOR THE OWNER AND FOR THE BUILDING PERMIT FILES. THE TREATMENT CERTIFICATE SHALL PROVIDE THE PRODUCT USED, IDENTITY OF THE APPLICATOR, TIME AND DATE OF THE TREATMENT, SITE LOCATION, AREA TREATED, CHEMICAL USED, PERCENT CONCENTRATION AND NUMBER OF GALLONS USED, TO ESTABLISH A VERIFIABLE RECORD OF PROTECTIVE TREATMENT. IF THE SOIL CHEMICAL BARRIER METHOD FOR TERMITE PREVENTION IS USED, FINAL EXTERIOR TREATMENT SHALL BE COMPLETED PRIOR TO FINAL BUILDING APPROVAL.
- A PERMANENT SIGN WHICH IDENTIFIES THE TERMITE TREATMENT PROVIDER AND NEED FOR RE-INSPECTION AND TREATMENT CONTRACT RENEWAL SHALL BE PROVIDED. THE SIGN SHALL BE POSTED NEAR THE WATER HEATER OR ELECTRICAL PANEL.
- ALL WORK RELATED TO TERMITE PREVENTION TO BE PERFORMED ACCORDING W/ 2017, FLORIDA BUILDING CODE, SECTION 1061, SUBSECTIONS & CURRENT UPDATES.

OPENING PROTECTION NOTE:

- ALL WINDOWS TO HAVE LAMINATED IMPACT RESISTANT GLASS, IN COMPLIANCE WITH 2017 FLORIDA BUILDING CODE.
- ALL WINDOWS & DOORS ARE TO BE TESTED IMPACT RESISTANT PRODUCTS INSTALLED PRECISELY AS INSTRUCTED BY THE MANUFACTURER.

CAST-IN-PLACE CONCRETE:

- VERIFY ALL DETAILS AND DIMENSIONS WITH EXISTING CONDITIONS, ARCHITECTURAL DOCUMENTS AND PROPERLY COORDINATED APPROVED SHOP DRAWINGS.
- ALL REINFORCED CONCRETE SHALL BE NORMAL WEIGHT. THE MINIMUM 28 DAY COMPRESSIVE STRENGTH SHALL BE AS FOLLOWS:
 a) FOOTING, SLAB ON GRADE: f_c = 2,500 psi
 b) COLUMNS & BEAMS: f_c = 3,000 psi
- EXPANSION AND CONTROL JOINTS ARE TO BE PLACED PER A.C.I. RECOMMENDATIONS. PREPARE A CRACK CONTROL PLAN BASED UPON CONSTRUCTION SEQUENCING AND PROPOSED ACTUAL FLOOR AND WALL FINISHES AND SUBMIT TO THE DESIGNER &/OR ENGINEER FOR APPROVAL PRIOR TO CONSTRUCTION.
- CONCRETE REINFORCING SHALL BE A615 - GRADE 60, f_y = 60,000 psi.
- LAP HORIZONTAL STL IN FOOTINGS AND TIE BEAMS 25" MIN.
- PROVIDE CORNER BARS IN FOOTINGS, AND TIE BEAMS TO MATCH HORIZONTAL STEEL AND LAP 25" MIN.
- WELDED WIRE FABRIC SHALL BE 6x6 W14xW14 U.N.O.
- SUBSTITUTION OF W.W.F. WITH FIBER-MESH REINFORCED CONCRETE FOR NON-ELEVATED FLOOR SLABS IS AN APPROVED ALTERNATIVE.

MASONRY:

- THE MASONRY CONTRACTOR MUST EMPLOY A CERTIFIED STRUCTURAL MASONRY INSPECTOR. THE INSPECTOR MUST BE IN ATTENDANCE AND MONITOR ALL REINFORCED MASONRY OPERATIONS INCLUDING DOWEL PLACEMENT.
- MINIMUM COMPRESSIVE STRENGTH OF BLOCK SHALL BE 2,000 psi (NET AREA).
- MINIMUM PRISM STRENGTH (1"m) SHALL BE 1,500 psi, U.N.O.
- MORTAR FOR MASONRY SHALL BE TYPE S OR M.
- GROUT BLOCK CELL FILL SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 2,500 psi AT 28 DAYS AT AN 8" TO 10" SLUMP.

WOOD FRAMING NOTES:

- ALL STRUCTURAL LUMBER AND EXTERIOR FRAMING TO BE #2 SOUTHERN PINE OR EQUIVALENT, EXCEPT AS SHOWN ON DRAWINGS.
- ALL WOOD SUBJECT TO MOISTURE EXPOSURE OR ADJACENT TO CONCRETE OR MASONRY SHALL BE OF AN APPROVED NATURALLY DURABLE SPECIES OR PRESERVATIVE TREATED APPROPRIATELY FOR ITS INTENDED USE.
- ROOFING PLYWOOD SHEATHING:
 15/32" APA RATED SHEATHING, UNBLOCKED DIAPHRAGM ALLOWABLE SHEAR = 255 LBS./FT. FASTEN TO TRUSSES OR RAFTERS W/ 8d RING SHANK OR DEFORMED NAILS SPACED 4" OC @ END CUTS & TERMINATIONS, 12" OC INTERIOR.
- WALL SHEATHING: 15/32" APA STRUCTURAL (I) PANEL, BLOCKED DIAPHRAGM ALLOWABLE SHEAR = 430 LBS./FT. FASTEN TO STUDS, PLATES & BLOCKING W/ 8d RING SHANK OR DEFORMED NAILS SPACED 12" OC @ INTERIOR SUPPORTS, 4" OC @ ALL ENDS & EDGES, 4" OC @ ALL CUTS, TERMINATIONS, TRANSITIONS & BOUNDARIES. ALL EXTERIOR WALL SHEATHING TO BE INSTALLED HORIZONTALLY & SOLID BLOCKED, STAGGER VERTICAL JOINTS.
- FLOOR SHEATHING:
 23/32" APA STURD-I-FLOOR, BLOCKED DIAPHRAGM, ALLOWABLE SHEAR = 320 LBS./FT. JOINTS GLUED, FASTEN TO TRUSSES, JOISTS & BLOCKING W/ 18 x 2 1/2" WOOD TO WOOD SCREWS SPACED 12" OC @ INTERIOR SUPPORTS, 4" OC @ ALL ENDS & EDGES, 4" OC @ ALL CUTS, TERMINATIONS, TRANSITIONS & BOUNDARIES.
- VERIFY SHEATHING TYPE AND THICKNESS WITH ROOF MATERIAL MANUFACTURER'S REQUIREMENTS FOR WIND LOADING RESISTANT ATTACHMENT.
- FOLLOW ALL REQUIREMENTS OF 2017 FLORIDA BUILDING CODE AND CURRENT UPDATES, FOR ALL WOOD FRAMING INCLUDING BUT NOT LIMITED TO CONNECTIONS, BRACING, BRIDGING AND NAILING.
- SUFFICIENT VENTILATION UNDER ROOF AREAS SHALL BE PROVIDED. (2017 F.B.C. 1203.2 / R2061)

HOLD-DOWN SPECIFICATION:

- ALL HOLD-DOWNS HANGERS, CLIPS, ETC. TO BE SIMPSON STRONG-TIE OR APPROVED EQUAL.
- ALL CONNECTORS AND FASTENER EXPOSED TO WEATHER SHALL BE LONG LIFE AND CORROSION RESISTANT.
- ALL CONNECTORS AND FASTENERS THROUGH OR ADJACENT TO A.C.Q. PRESERVATIVE TREATED LUMBER ARE TO BE HOT DIPPED GALVANIZED, STAINLESS STEEL OR SPECIFICALLY APPROVED FOR SUCH USAGE BY THE MANUFACTURER.


FASTENER REQUIREMENTS:

WINDOWS, DOORS & ROOFING: PER MANUFACTURER'S RECOMMENDATIONS, TO MEET DESIGN PRESSURES LISTED HEREIN.

CONNECTOR	MANUFACTURER	FLA. PROJ. APP. #
Δ34	SIMPSON	10446.1
META 15		10852.9
LWS 210		10655.31
META 16		11473.3
CBBS28-20B2		10860.7
LSTA 21		10852.6
H10		10456.3
H8		10456.3
HUSC210-2		10655.25
LCE4		10446.11
ΔE400		10880.4
HUSC410		10531.26
VT2		10861.5
H05		11470.4
LSTA15		10852.6
LSTA 12		10852.6

CONNECTOR TABLE CONT'D ON A-1A

**FIGURE 1609.6.2.2
 COMPONENT AND CLADDING PRESSURE**

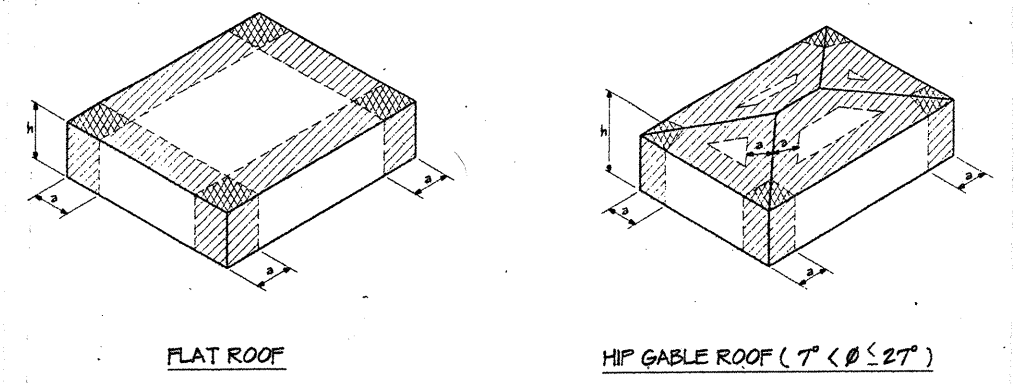


INTERIOR ZONES ROOFS - ZONE 1/WALLS - ZONE 4
 END ZONES ROOFS - ZONE 2/WALLS - ZONE 6
 CORNER ZONES ROOFS - ZONE 3

TABLE R3012(2)
 COMPONENT AND CLADDING WIND LOADS FOR A BUILDING (psf)
 WIND SPEED (V₁₀) 150 MPH
 MEAN ROOF HEIGHT: 15 FEET
 EXPOSURE: B
 HT & EXP. COEFFICIENT: 1.00

ZONE	EFFECTIVE WIND AREA (A _E)	DESIGN WIND SPEED (MPH)	WIND PRESSURE (+/-)	WIND SUCTION (-)
ROOF ANGLE 37-27 DEGREES (1/4 TO 3/4)				
1	100.0	14.0	-22.2	-22.2
2	20.0	12.0	-21.6	-21.6
3	50.0	11.2	-20.8	-20.8
4	100.0	9.0	-20.2	-20.2
5	10.0	14.0	-20.8	-20.8
6	20.0	12.0	-20.4	-20.4
7	50.0	11.2	-20.8	-20.8
8	100.0	9.0	-20.8	-20.8
9	10.0	14.0	-20.2	-20.2
10	20.0	12.0	-20.4	-20.4
11	50.0	11.2	-20.4	-20.4
12	100.0	9.0	-20.4	-20.4
WALL				
13	10.0	24.5	-26.4	-26.4
14	20.0	23.2	-25.2	-25.2
15	50.0	22.0	-25.8	-25.8
16	100.0	20.7	-22.7	-22.7
17	500.0	19.1	-22.2	-22.2
18	10.0	24.5	-25.8	-25.8
19	20.0	23.2	-25.4	-25.4
20	50.0	22.0	-27.9	-27.9
21	100.0	20.7	-25.2	-25.2
22	500.0	19.1	-22.2	-22.2

LEGAL DESCRIPTION:

LOTS 32 AND 33, WOODLAW PARK G.L. BLDG. U.S. SUBDIVISION, AS RECORDED IN PLAT BOOK 3, PAGES 49 AND 50 OF THE PUBLIC RECORDS OF MIAMI-DADE COUNTY, FL.


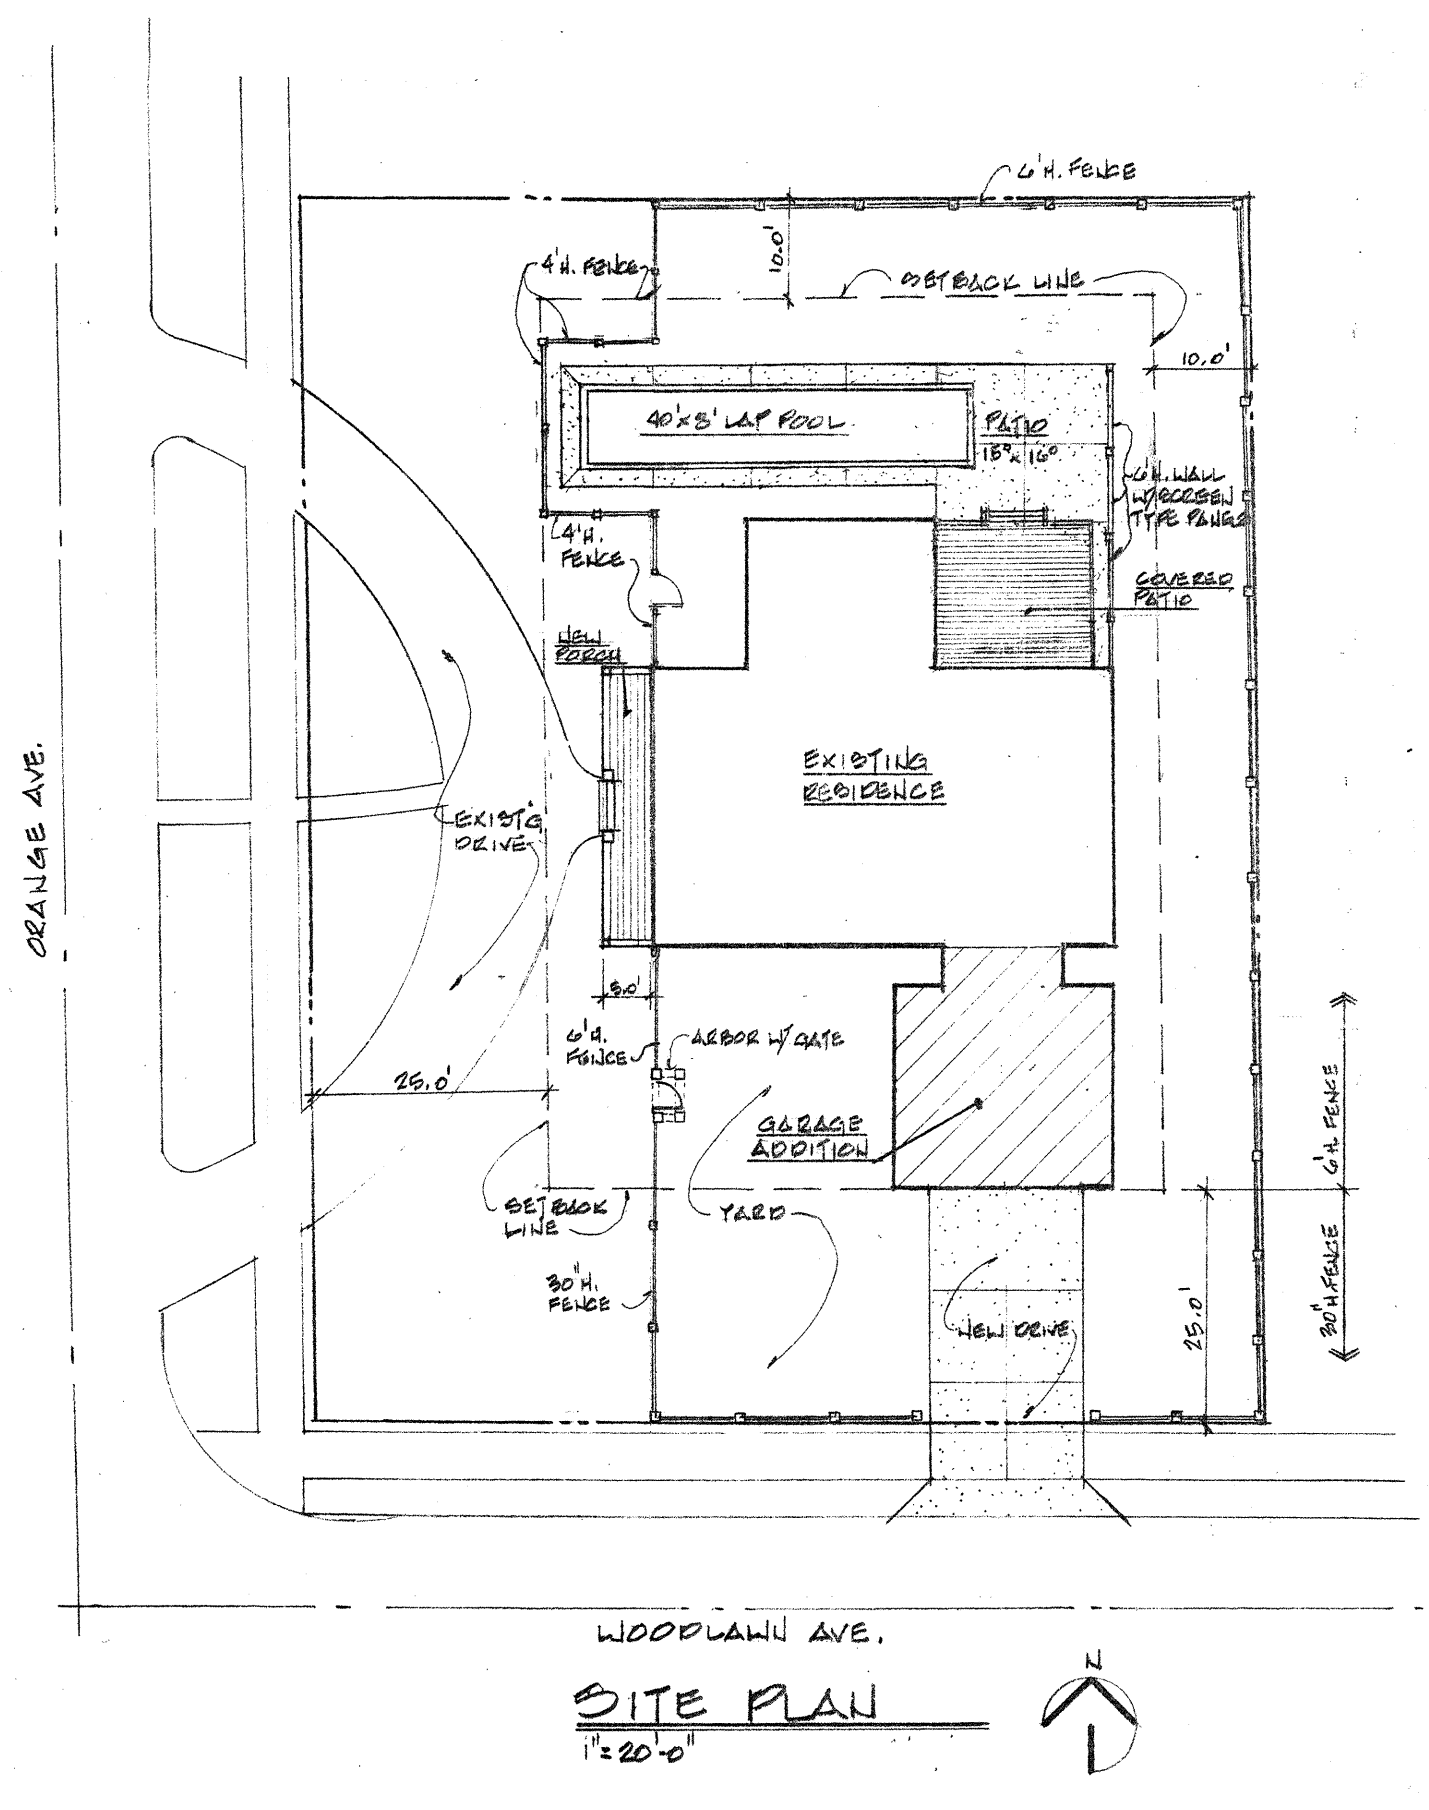


**SITE PLAN
 1" = 20'-0"**


REVISIONS	DATE

**BARRY P. ULLMANN
 ARCHITECT, LLC**
 615 S. MISSOURI AVE., SUITE B
 CLEARWATER, FLORIDA, 33756
 barryullmann@aol.com
 727-441-4405


ADDITION TO AND REPAIRS OF
THE IRWIN RESIDENCE
 1400 ORANGE AVE.
 BELLEAIR, FL.




JOB No. 201801
 DRAWN BY: [Signature]
 CHECKED BY: [Signature]
 DATE: 10/22/18
 SHEET No. A-1
 OF 10

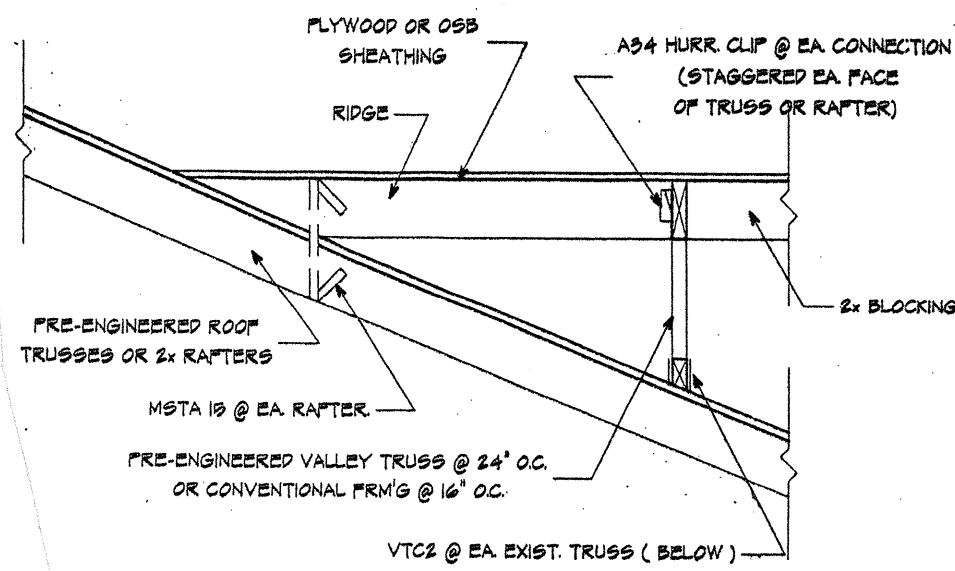


1 OVERFRAMING DETAIL
TYPICAL - NO SCALE

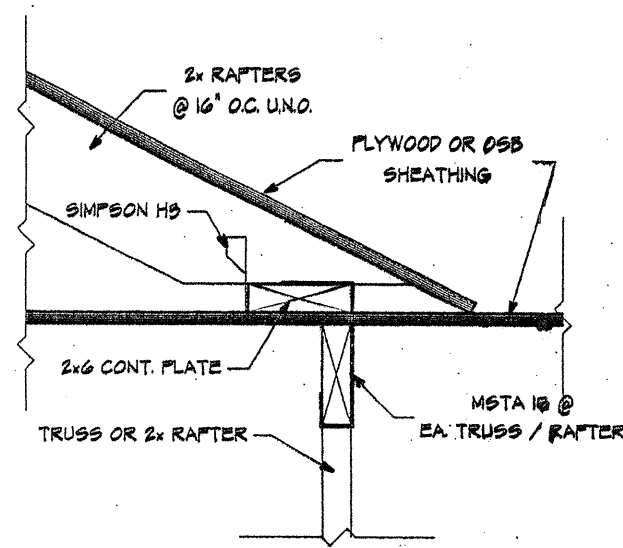

2 VALLEY CONNECTION DETAIL
SCALE: NONE

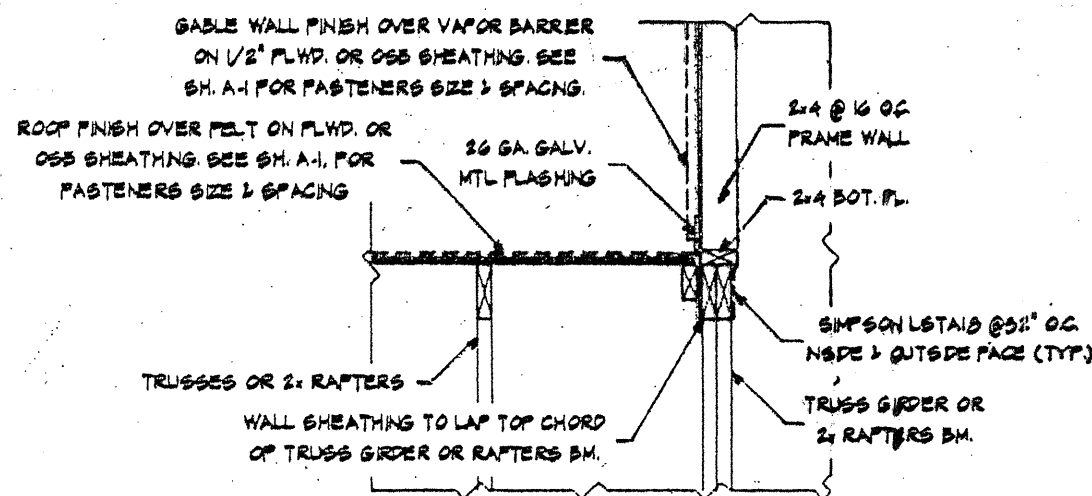


3 TYPICAL FLASHING DETAIL
SCALE: NONE

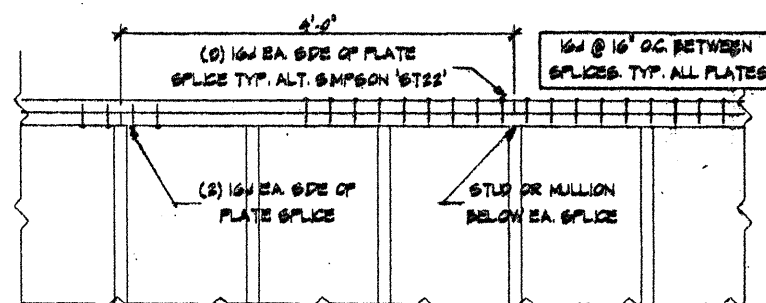


4 PLATE SPLICE DETAIL
TYPICAL


BEAMS & HEADERS CONNECTION DIAGRAM

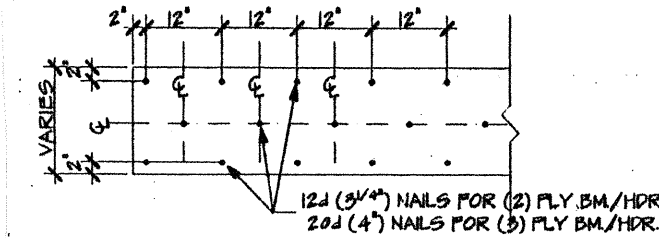

NOTE:
1- CONNECTION DIAGRAM SHOWN IS TYPICAL FOR ALL MULTIPLY LVL BEAMS OR HEADERS, (2) 2x+1/2\"/>

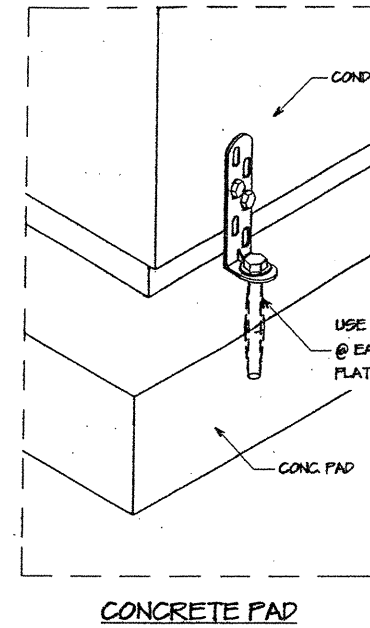

UNIVERSAL
CONDENSING
UNIT
TIE DOWN

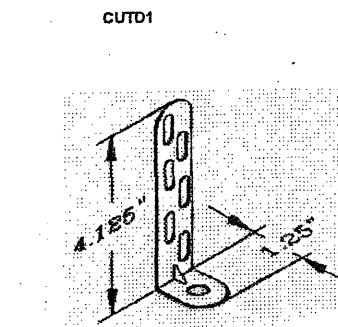


FEATURES AND CONSTRUCTION


Material: Fabricated from cold-rolled galvanized steel as per ASTM A 653.
Gauge: 14 Gauge / G-90.

FLORIDA PRODUCT APPROVAL TABLE				
CATEGORY	SUB-CATEGORY	DESCRIPTION	MANUFACTURER	PROD. NO.
WINDOW	DOUBLE HUNG	VINYL IMPACT	SIMONTON	5419.1
ROOFING	ASPHALT SHINGLES	FIBERGLASS	GAF	10124.1
"	UNDERLAYMENTS	PEEL AND STICK	TARCO	10450.1
PANEL WALL	SOFFIT	VENTED CEMENTITIOUS	HARDIE	19265.1
"	SIDING	CEMENTITIOUS	HARDIE	19192.2
EXTERIOR DOORS	SWINGING SINGLE	IMPACT FIBERGLASS	PLASTPRO	19219.1
"	SWINGING SINGLE	IMPACT GIBSO FIBERGLASS	PLASTPRO	19210.4
"	SWINGING DOUBLE	"	"	19210.6
"	SECTIONAL	IMPACT STEEL	CLOPAT	15904.2
ROOFING	MODIFIED BITUMEN	GRANULAR SURFACE	GAF	5000.1

WOOD CONNECTOR TABLE CONT'D		
CONNECTOR	MANUFACTURER	FL. PROD. APPROVAL NO.
LSTA 18	SIMPSON	10852.6
LSTA 21		10852.6
HETA 12		11479.3
HETA 16		11479.3
BCAL		10860
BCP 2.4A		10860
LBU 20		10447.5
LW 24		10658.31
LW 28		10658.31
SP-1		10496.11
SP-2		10496.11

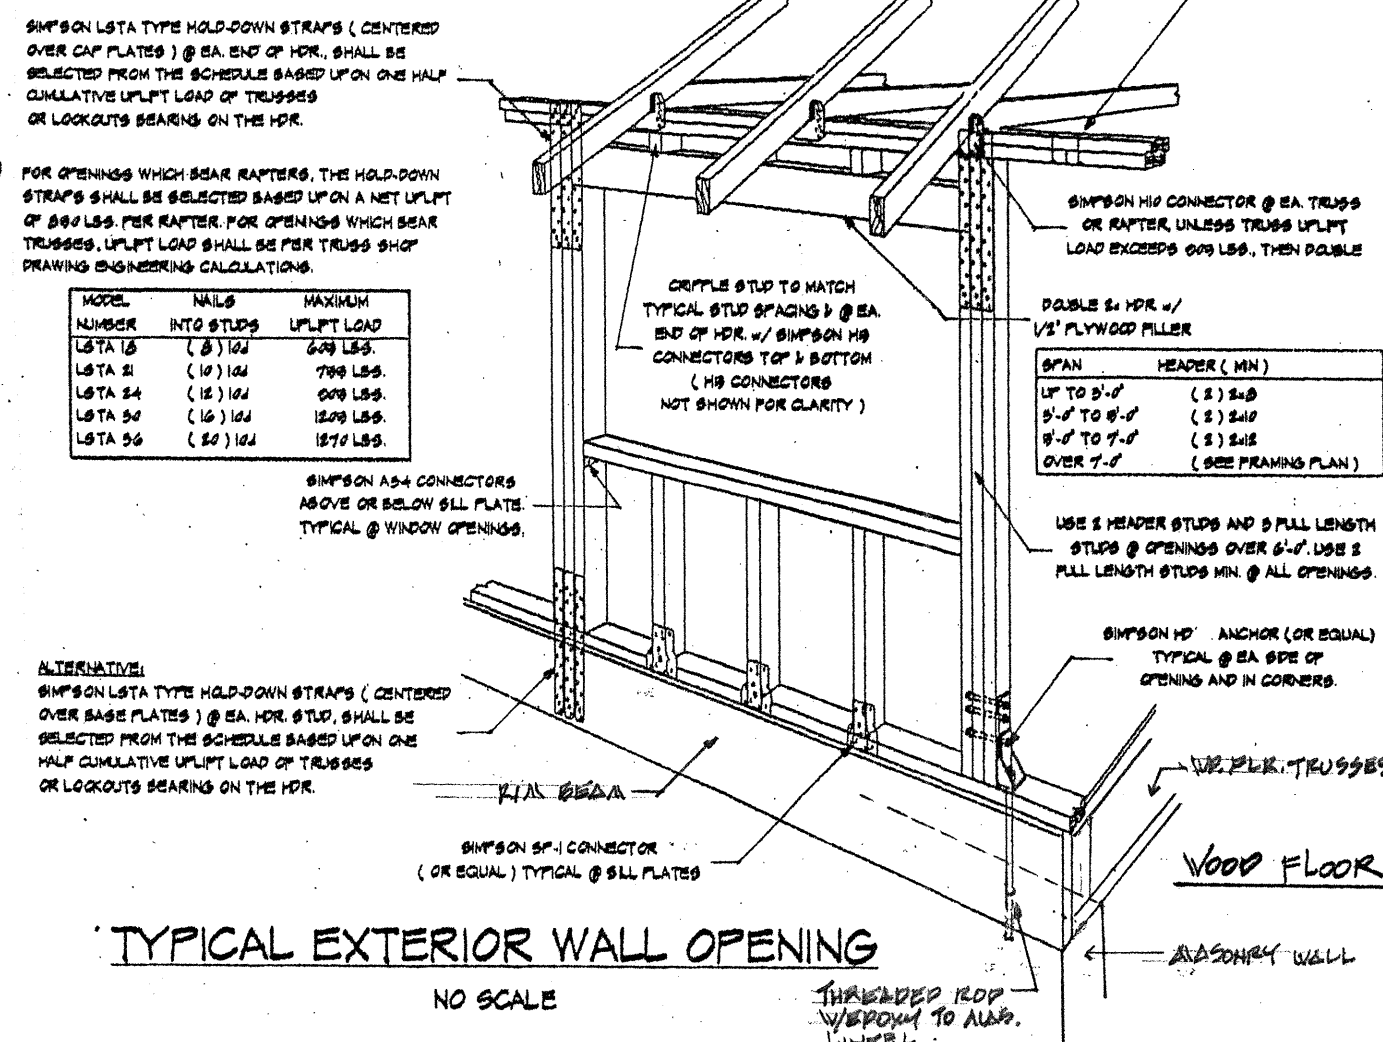

TYPICAL EXTERIOR WALL OPENING
NO SCALE


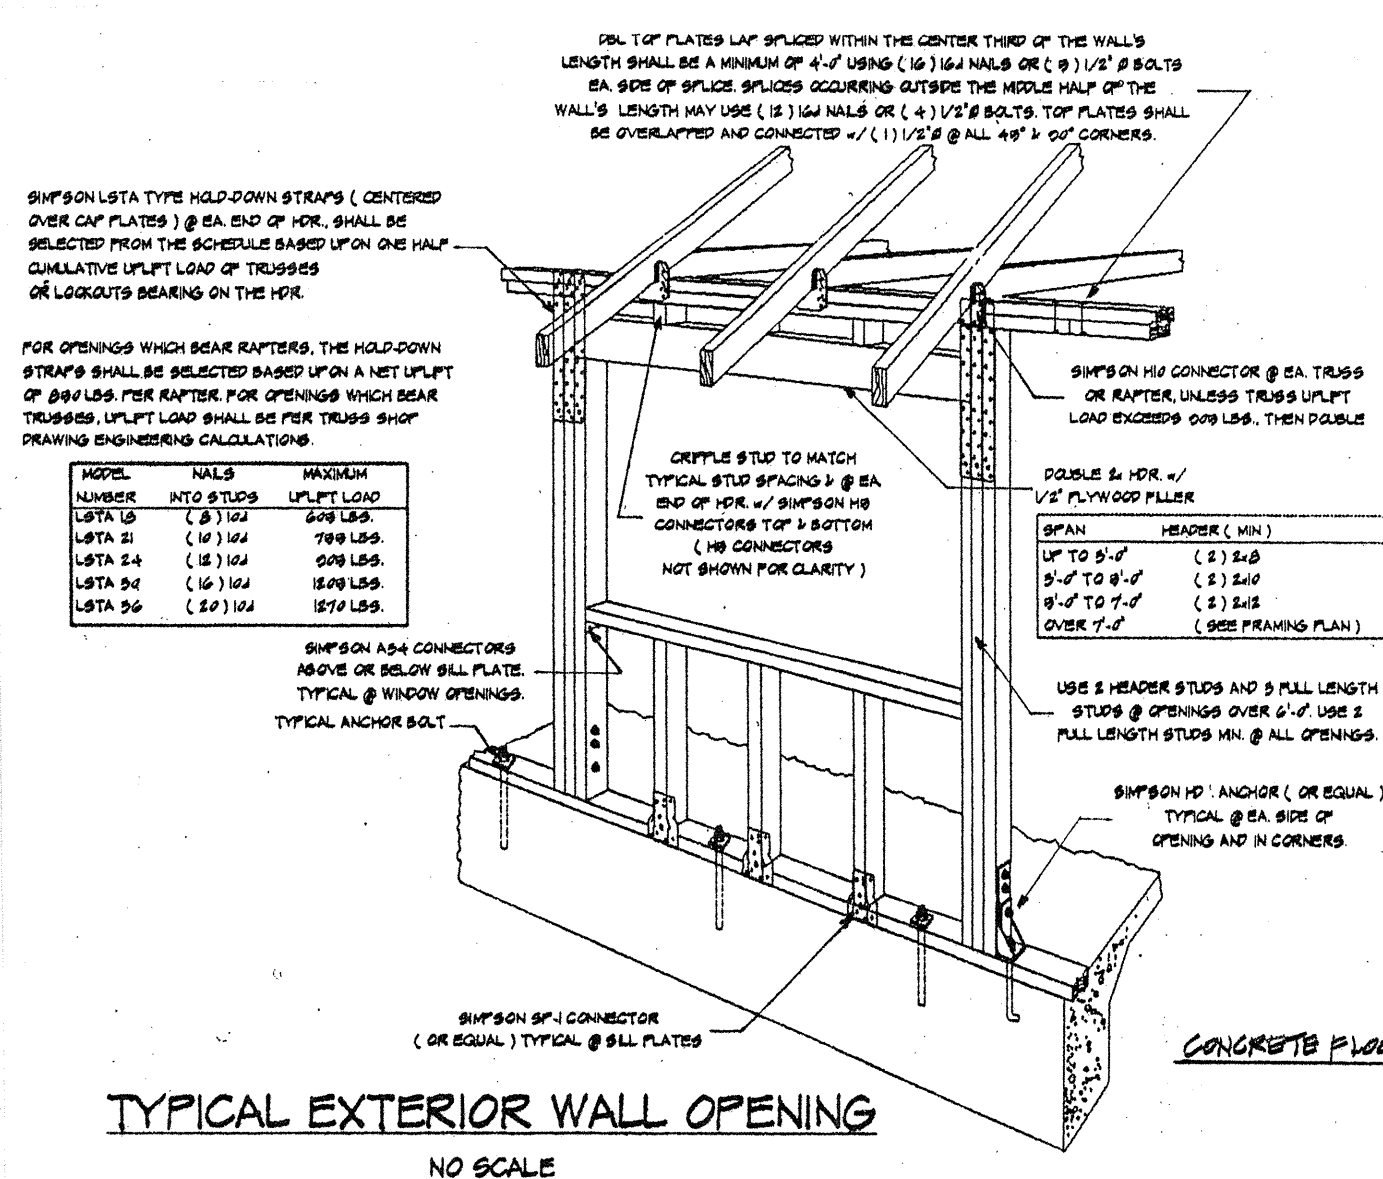


TYPICAL EXTERIOR WALL OPENING
NO SCALE

DATE

REVISIONS


ADDITION TO AND REVISIONS OF
THE IRWIN RESIDENCE
1400 ORANGE AVE.
DEWEAR, FL



JOB NO.
201887
DRAWN BY:
WU
CHECKED BY:
WU
DATE:
10/22/18
SHEET NO.

A-1A
OF 10

BARRY P. ULLMANN
ARCHITECT, LLC
615 S. MISSOURI AVE. SUITE B
CLEARWATER, FLORIDA 33756
727-441-4405
barryullmann@aol.com

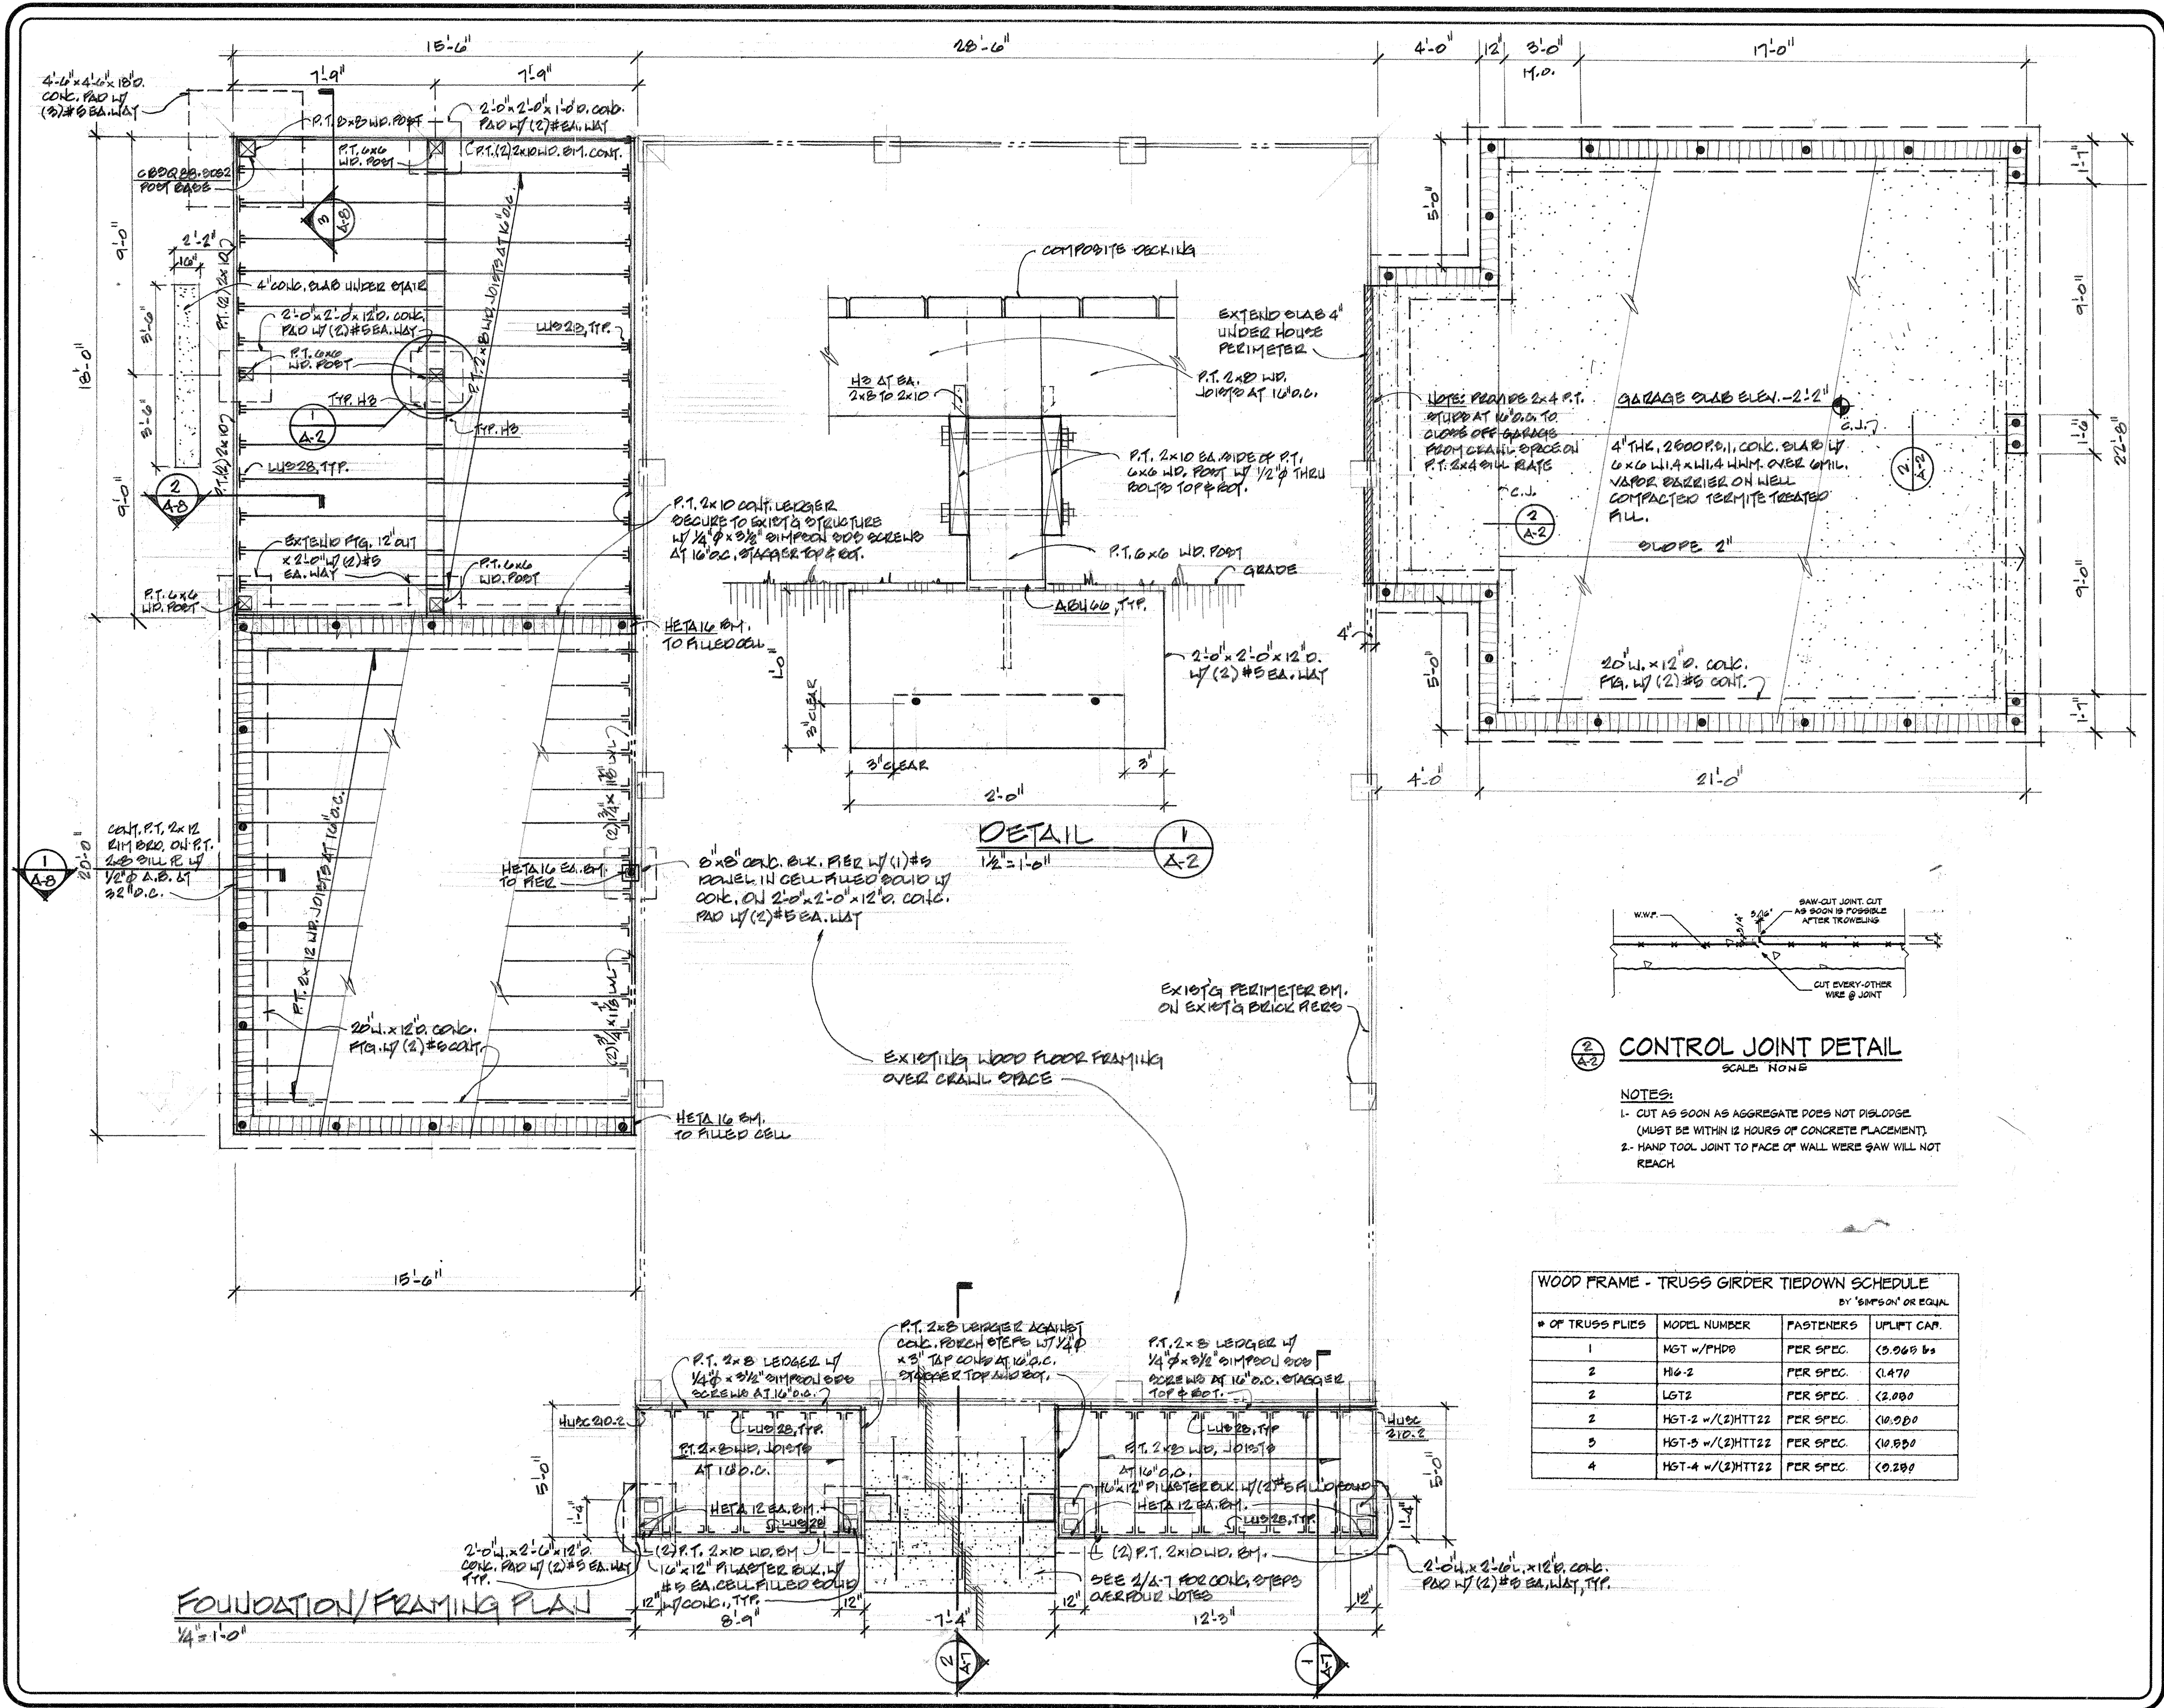

FOUNDATION/FRAMING PLAN
1/4" = 1'-0"

DETAIL 1
1/2" = 1'-0"

CONTROL JOINT DETAIL
SCALE: NONE

- NOTES:**
- 1- CUT AS SOON AS AGGREGATE DOES NOT DISLodge (MUST BE WITHIN 12 HOURS OF CONCRETE PLACEMENT).
 - 2- HAND TOOL JOINT TO FACE OF WALL WHERE SAW WILL NOT REACH



WOOD FRAME - TRUSS GIRDER TIEDOWN SCHEDULE
BY 'SIMPSON' OR EQUIV.

# OF TRUSS PLYS	MODEL NUMBER	FASTENERS	UPLIFT CAP.
1	HGT w/PHDS	PER SPEC.	(3,065) lbs
2	HGT-2	PER SPEC.	(1,470)
2	LGT2	PER SPEC.	(2,000)
2	HGT-2 w/(2)HTT22	PER SPEC.	(10,000)
3	HGT-3 w/(2)HTT22	PER SPEC.	(10,000)
4	HGT-4 w/(2)HTT22	PER SPEC.	(10,200)


REVISIONS	DATE

BARRY P. ULLMANN ARCHITECT, LLC
615 S. MISSOURI AVE., SUITE B
CLEARWATER, FLORIDA 34756
727-441-4405
barryullmann@aol.com

ADDITION TO AND REPAIRS OF
THE IRWIN RESIDENCE
1400 ORANGE AVE.
CLEARWATER, FL



JOB No.
201801
DRAWN BY:
Mfu
CHECKED BY:
DATE:
10/22/18
SHEET No.

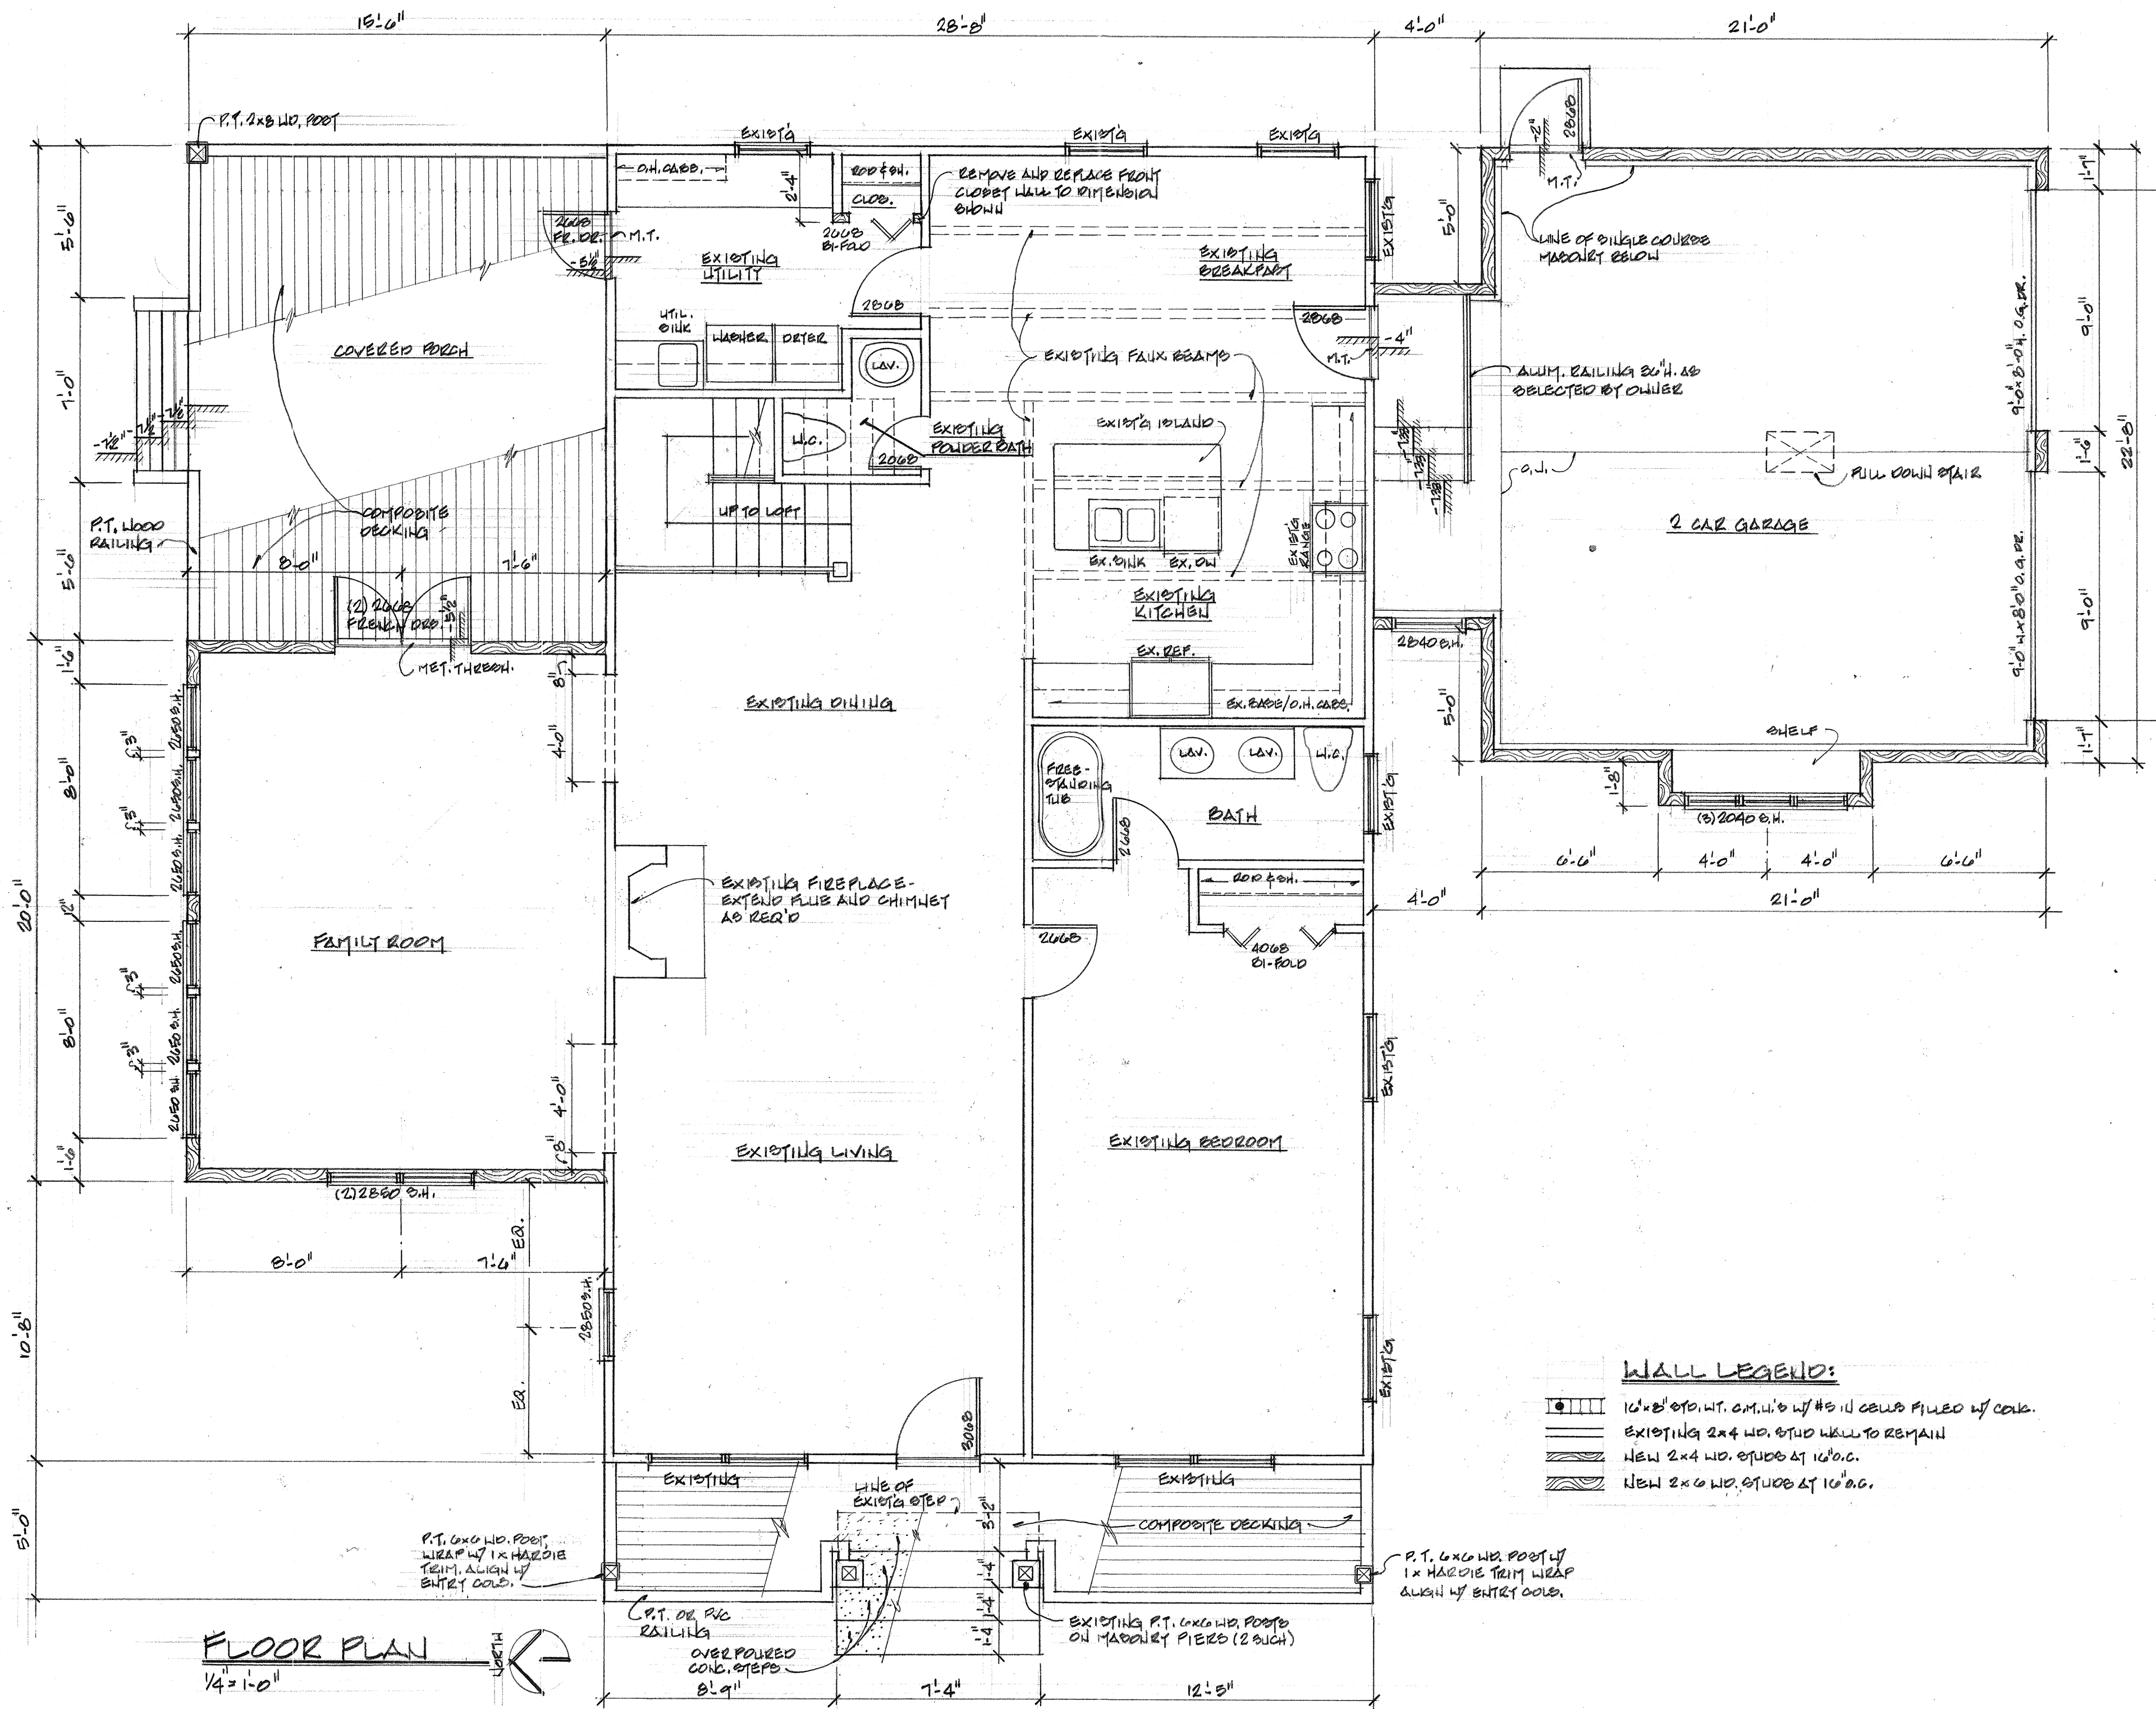

FLOOR PLAN
 1/4" = 1'-0"
 NORTH


WALL LEGEND:

- 16" x 8" STD. WT. CM.U.'S w/ #5 U' S CELLS FILLED w/ CON.
- EXISTING 2x4 HD. STUD WALL TO REMAIN
- NEW 2x4 HD. STUDS AT 16" O.C.
- NEW 2x6 HD. STUDS AT 16" O.C.


REVISIONS	DATE

BARRY P. ULLMANN ARCHITECT, LLC
 615 S. MISSOURI AVE., SUITE B CLEARWATER, FLORIDA 33756
 727-441-4405
 barryullmann@aol.com


ADDITION TO AND REMODELING OF
THE IRWIN RESIDENCE
 1466 ORANGE AVE.
 BELESTAR, FL



JOB NO. 101851
 DRAWN BY: LD
 CHECKED BY: [Signature]
 DATE: 10/24/10
 SHEET NO.

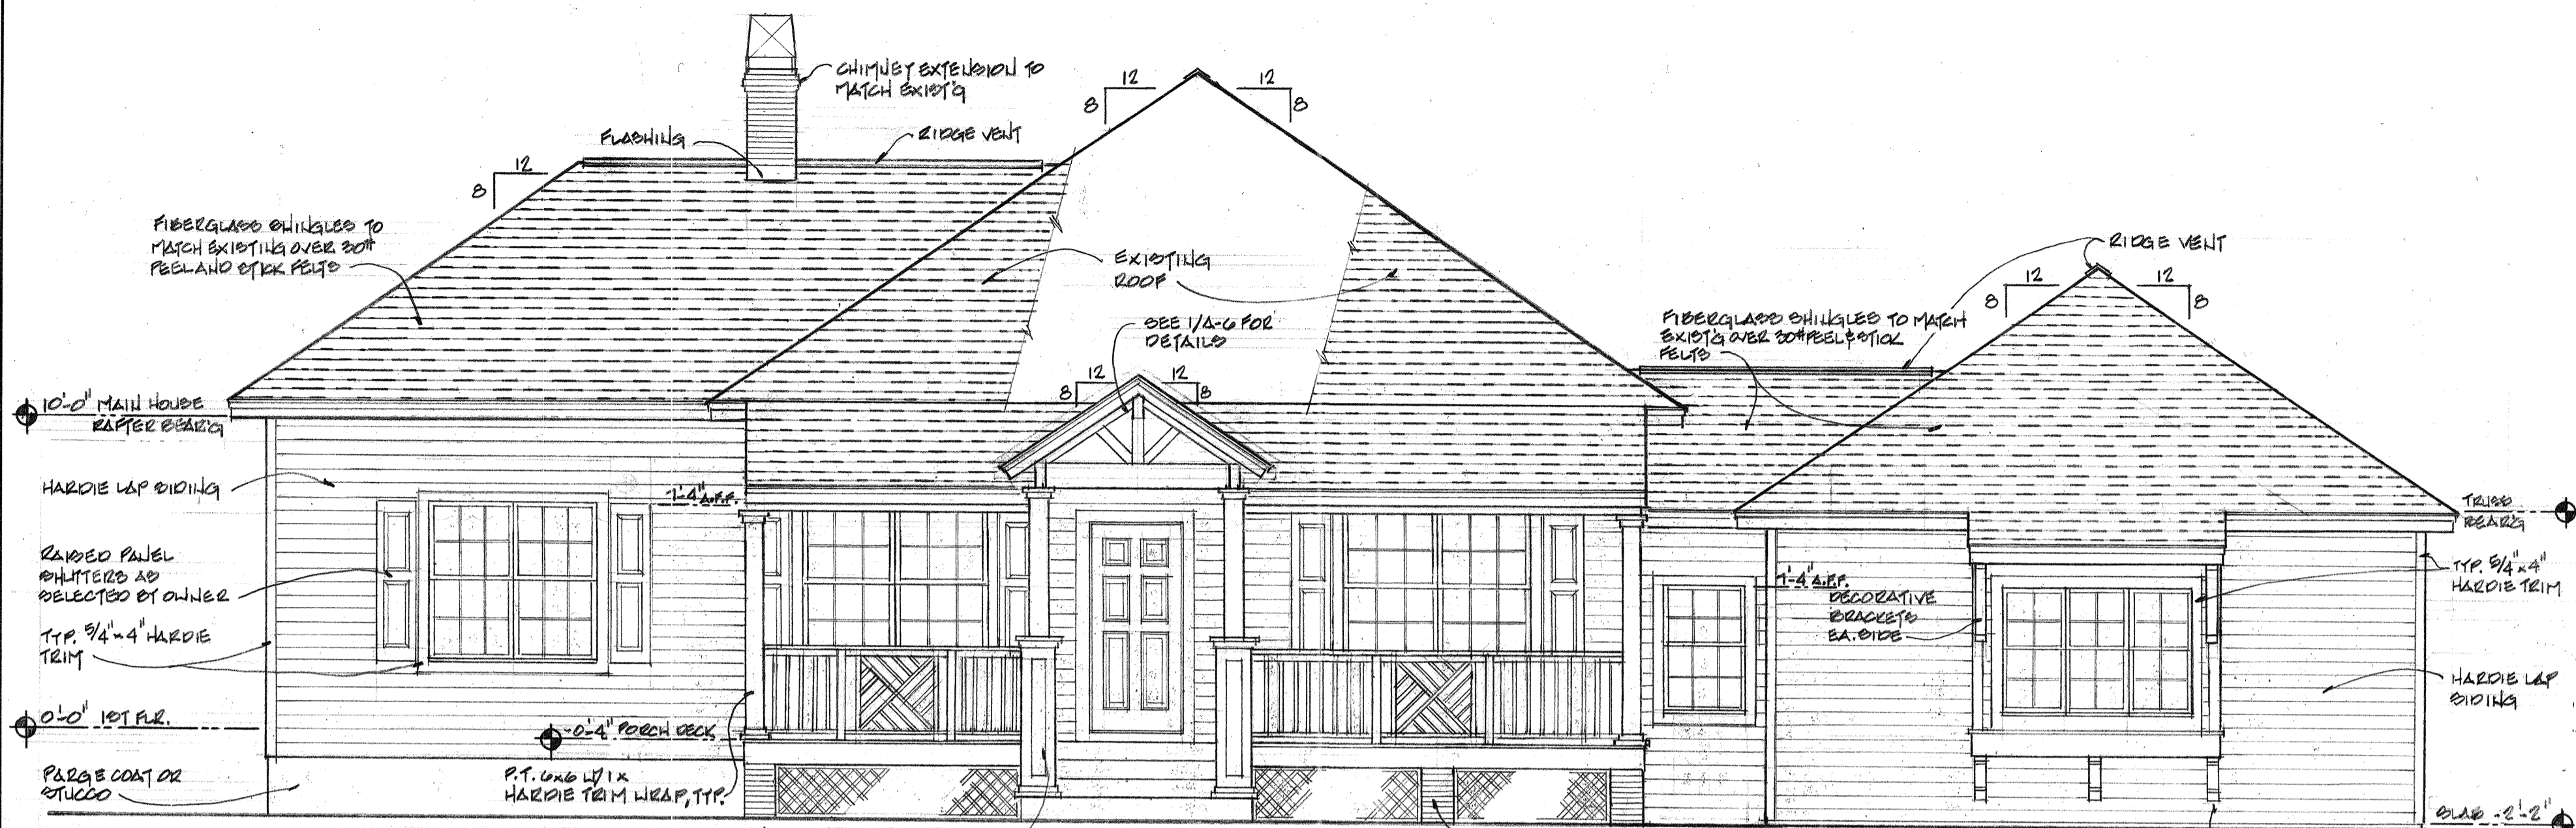

FRONT (WEST) ELEVATION
 $\frac{1}{4}'' = 1'-0''$

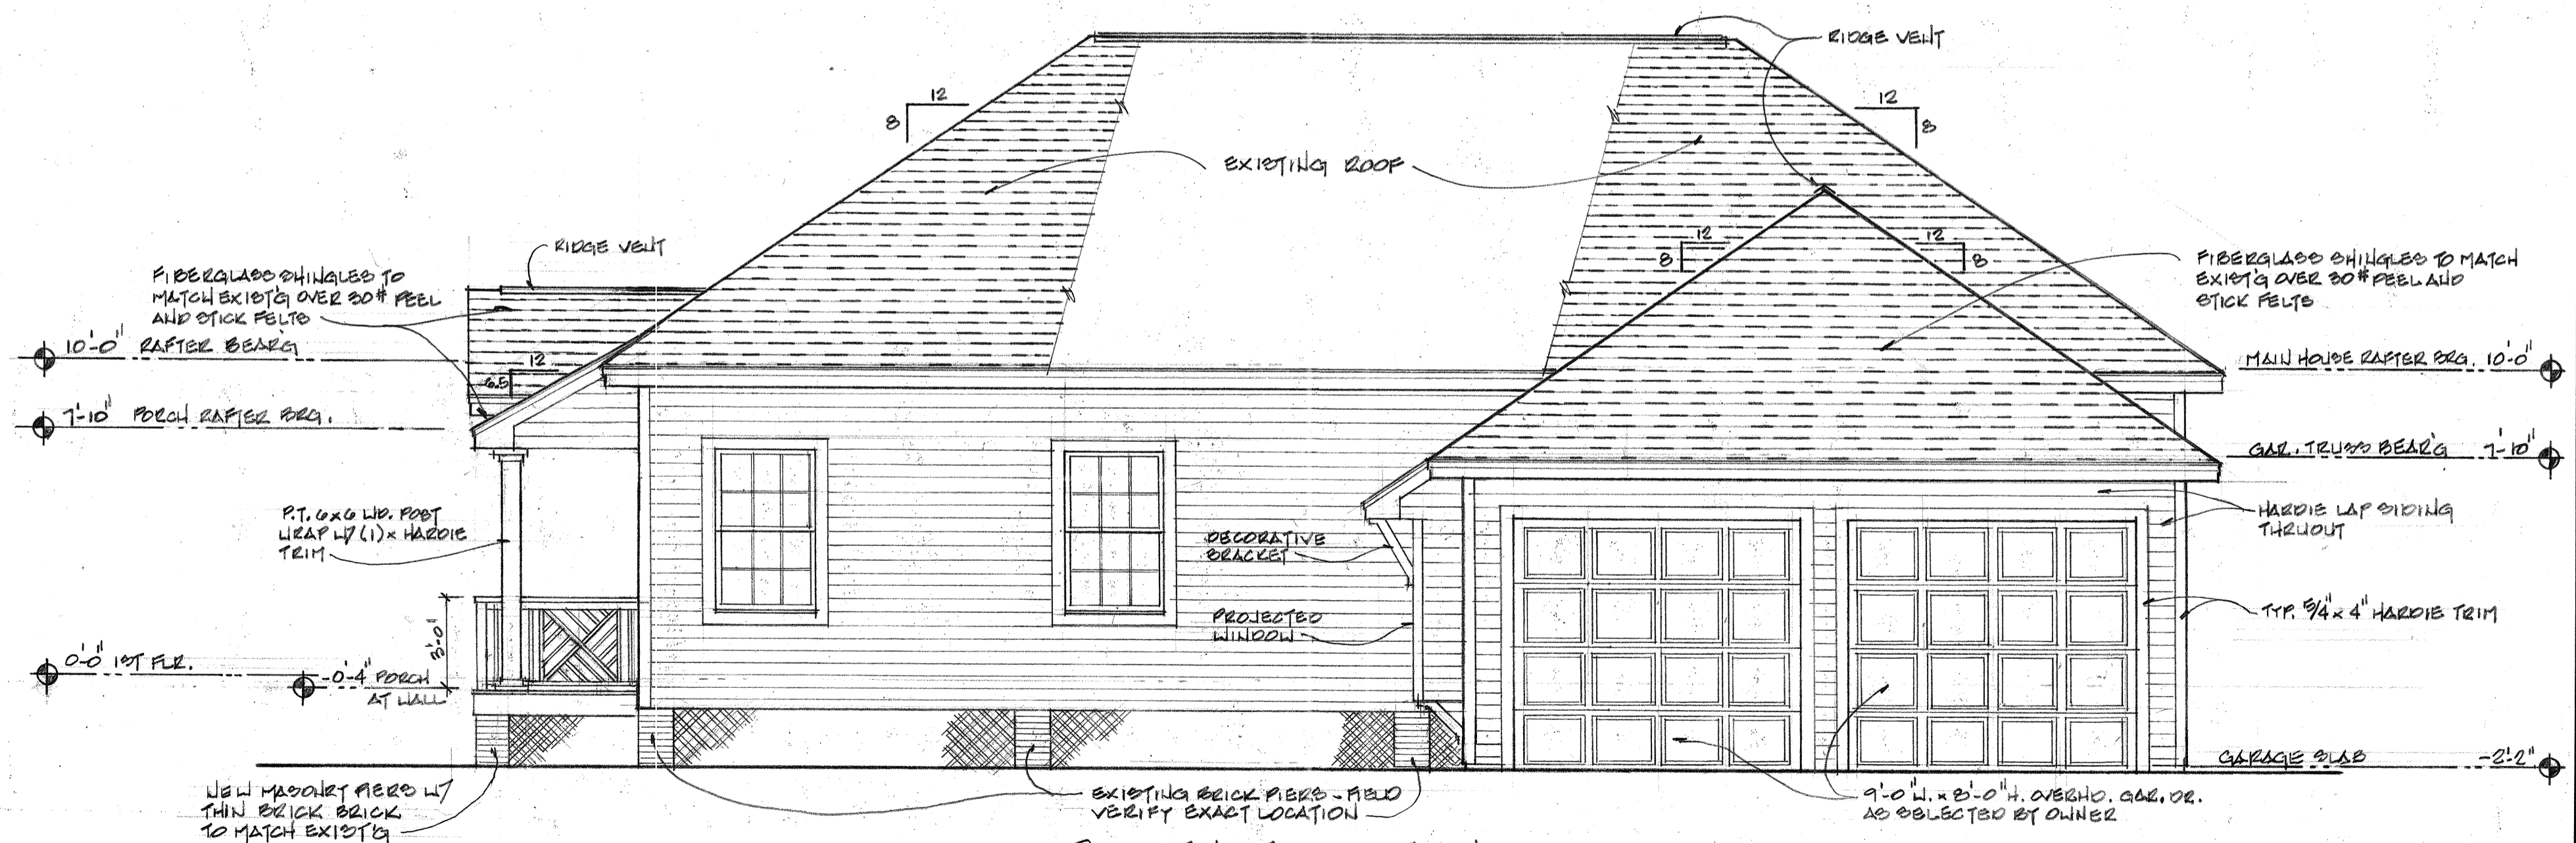


SOUTH ELEVATION
 $\frac{1}{4}'' = 1'-0''$

REVISIONS	DATE


BARRY P. ULLMANN
ARCHITECT, LLC
 615 S. MISSOURI AVE., SUITE B
 CLEARWATER, FLORIDA 33756
 727-441-4405
 baryullmann@aol.com

ADDITION TO AND REMODELING OF
THE IRWIN RESIDENCE
 1400 ORANGE AVE.
 BELLEAIR, FL




JOB No. 201807
 DRAWN BY: LD
 CHECKED BY: [Signature]
 DATE: 10/22/18
 SHEET No.

A-4
 OF 10

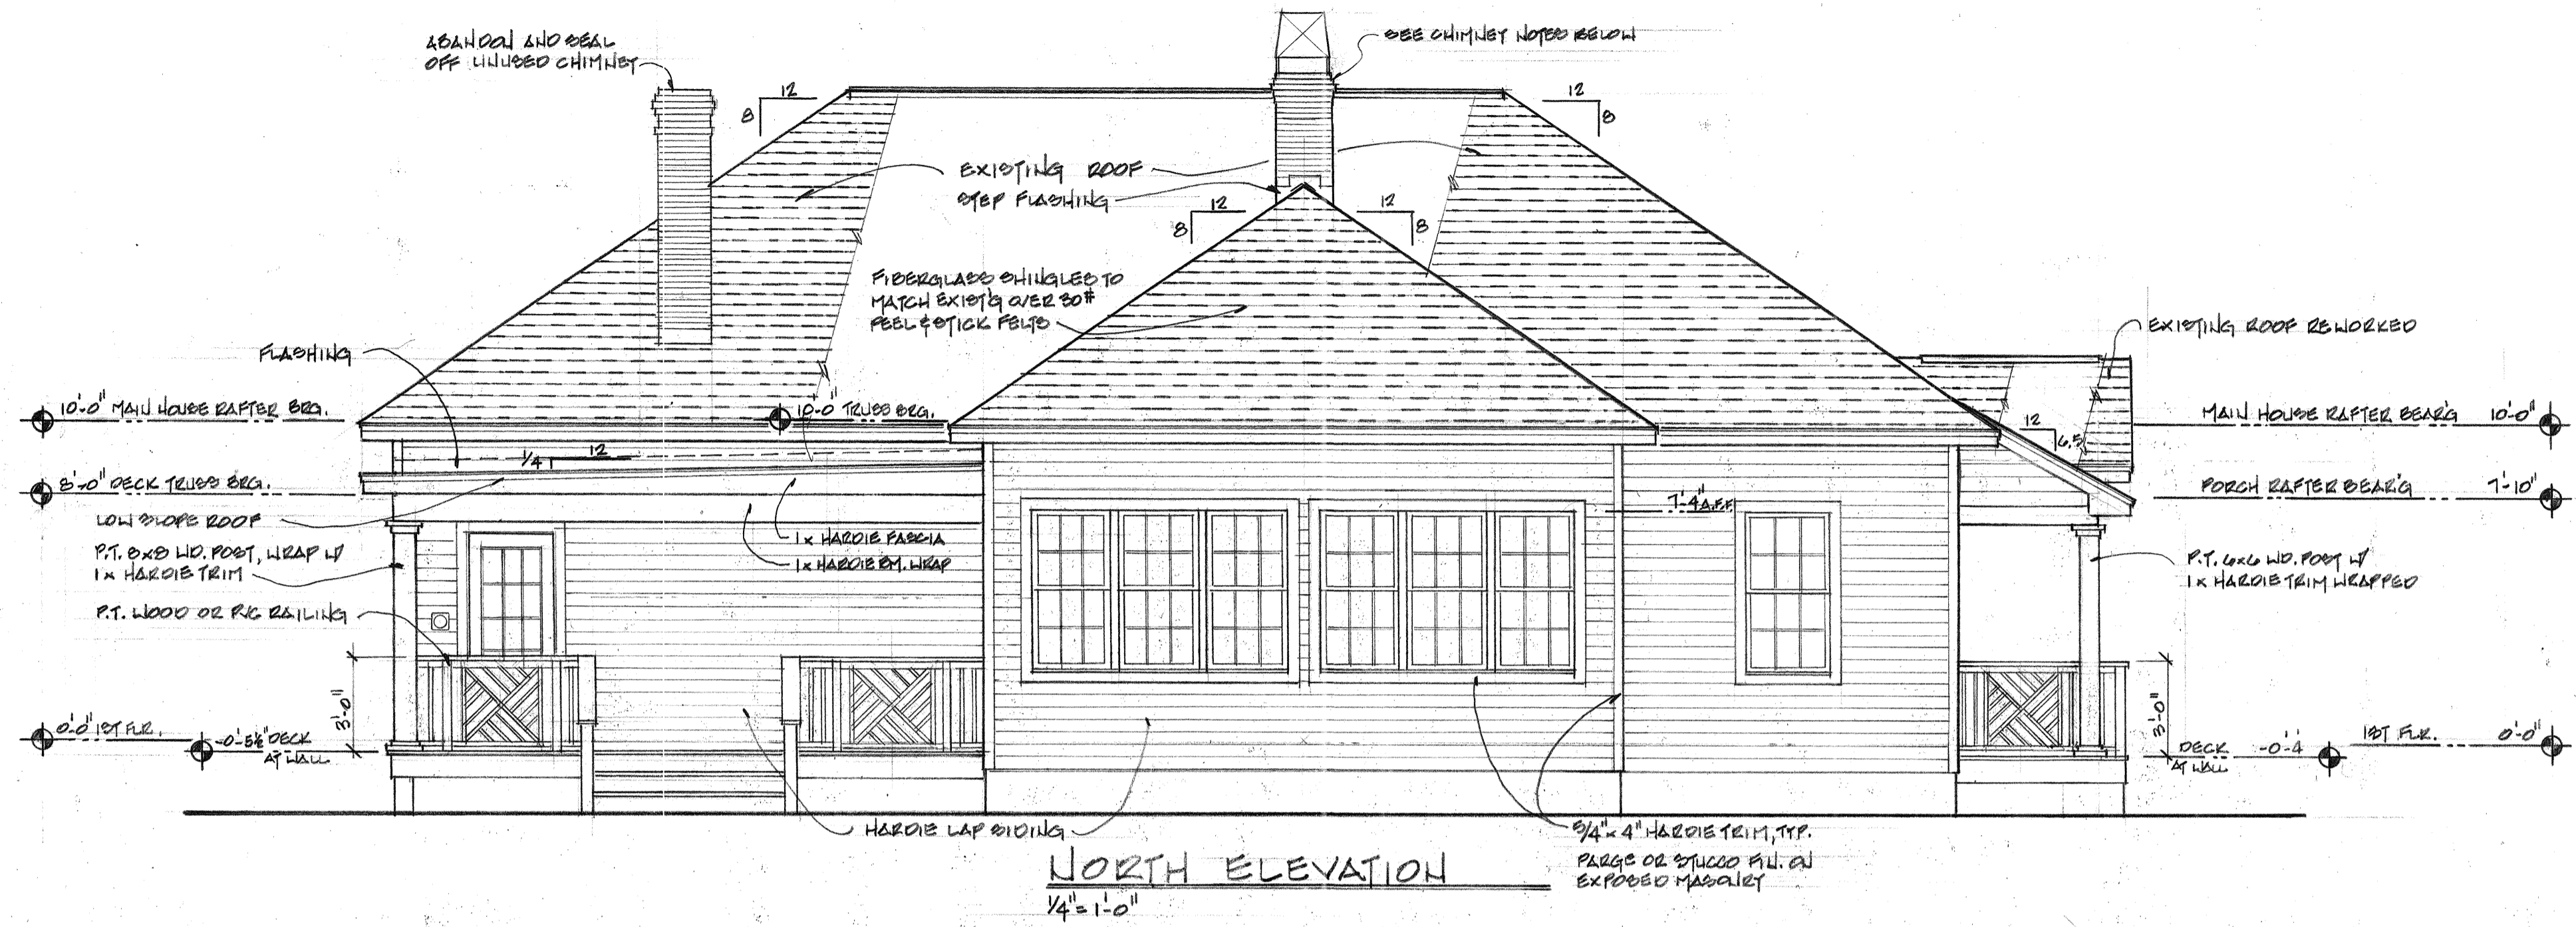

NORTH ELEVATION
1/4" = 1'-0"


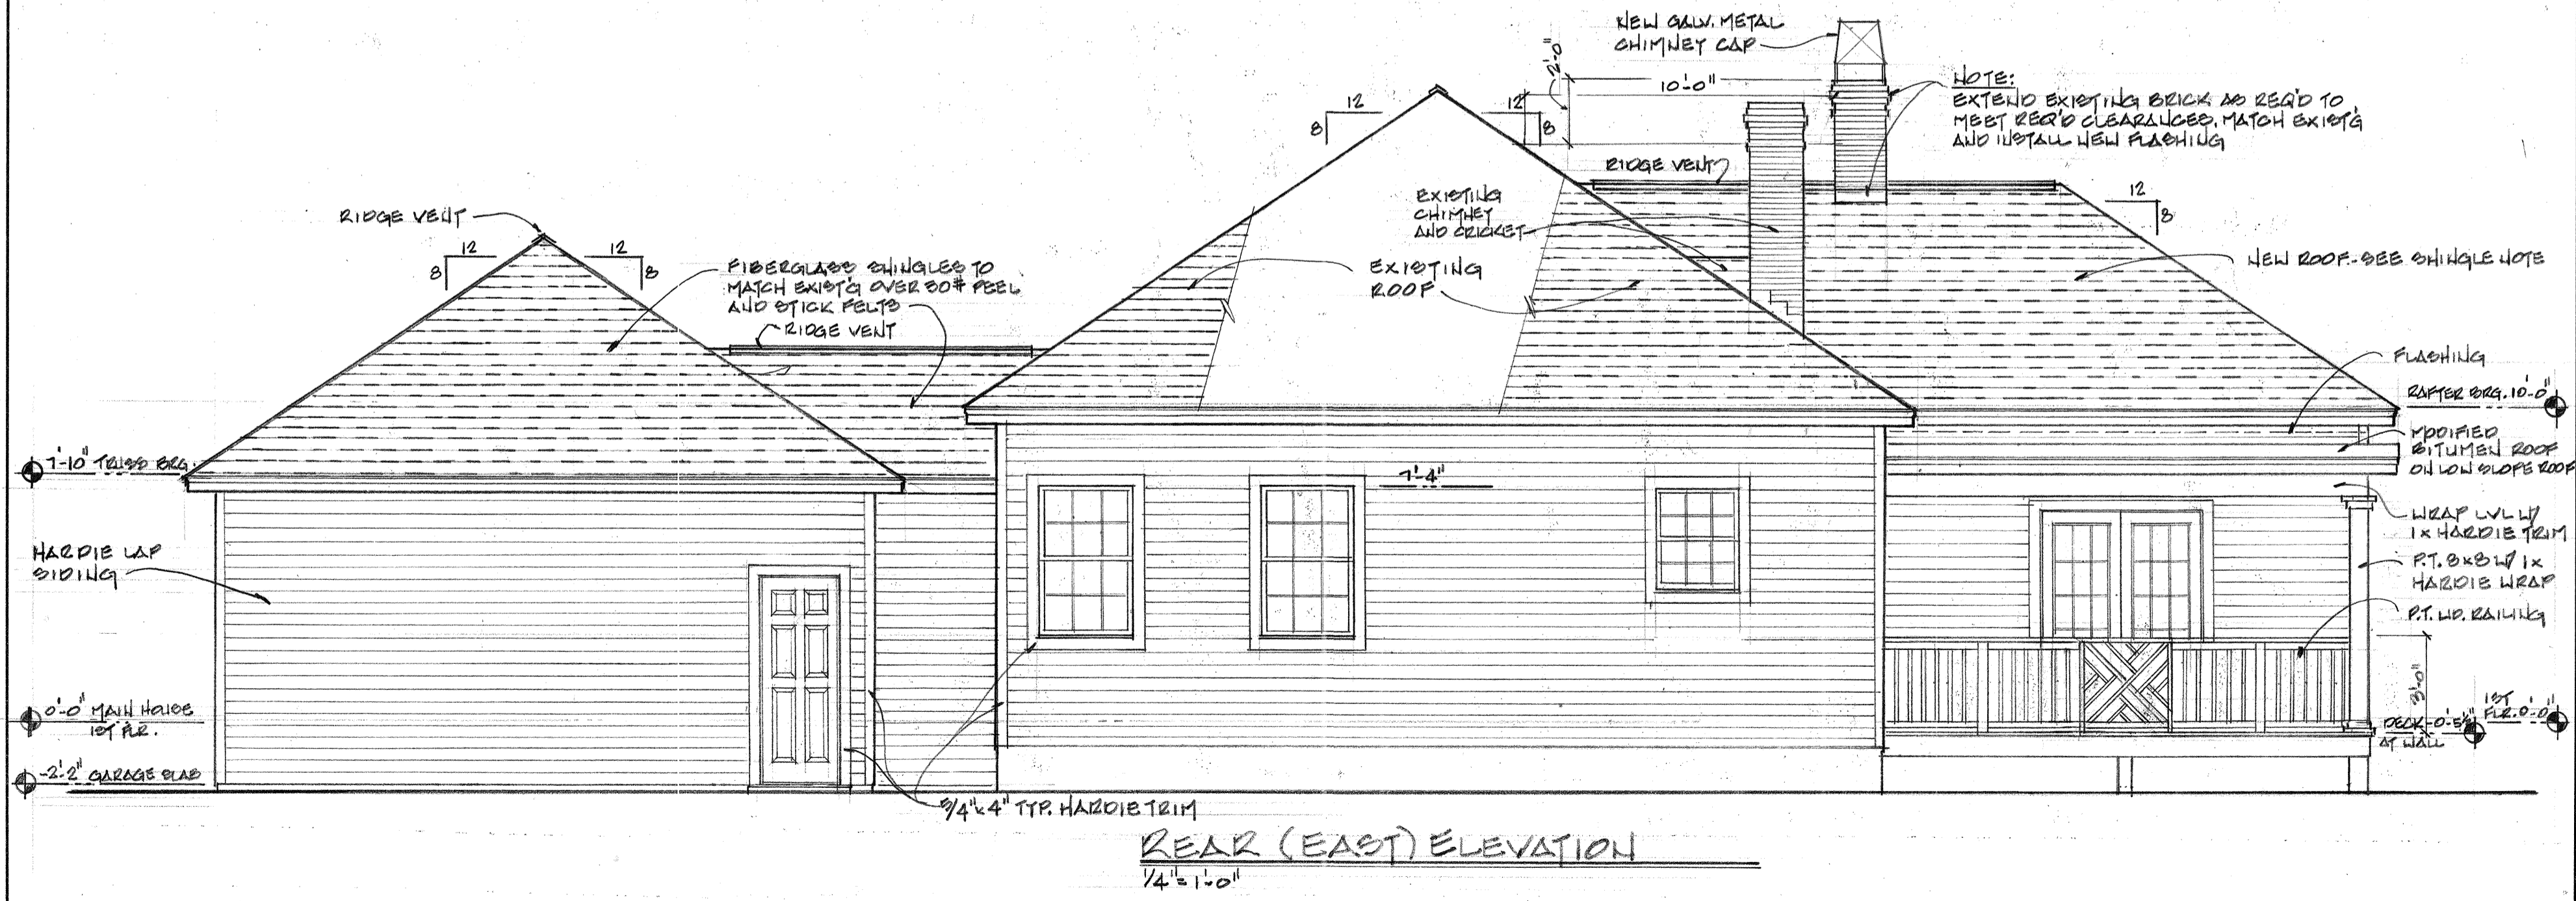


REAR (EAST) ELEVATION
1/4" = 1'-0"

REVISIONS	DATE


BARRY P. ULLMANN ARCHITECT, LLC
615 S. MISSOURI AVE. SUITE B
CLEARWATER, FLORIDA 34756
727-441-4405
barryullmann@aol.com

ADDITION TO AND REMODELING OF
THE IRWIN RESIDENCE
1400 ORANGE AVE.
DELEWARE, FL



JOB No.	201851
DRAWN BY:	LD
CHECKED BY:	DJH
DATE:	10/22/18
SHEET No.	A5

A5
OF 10

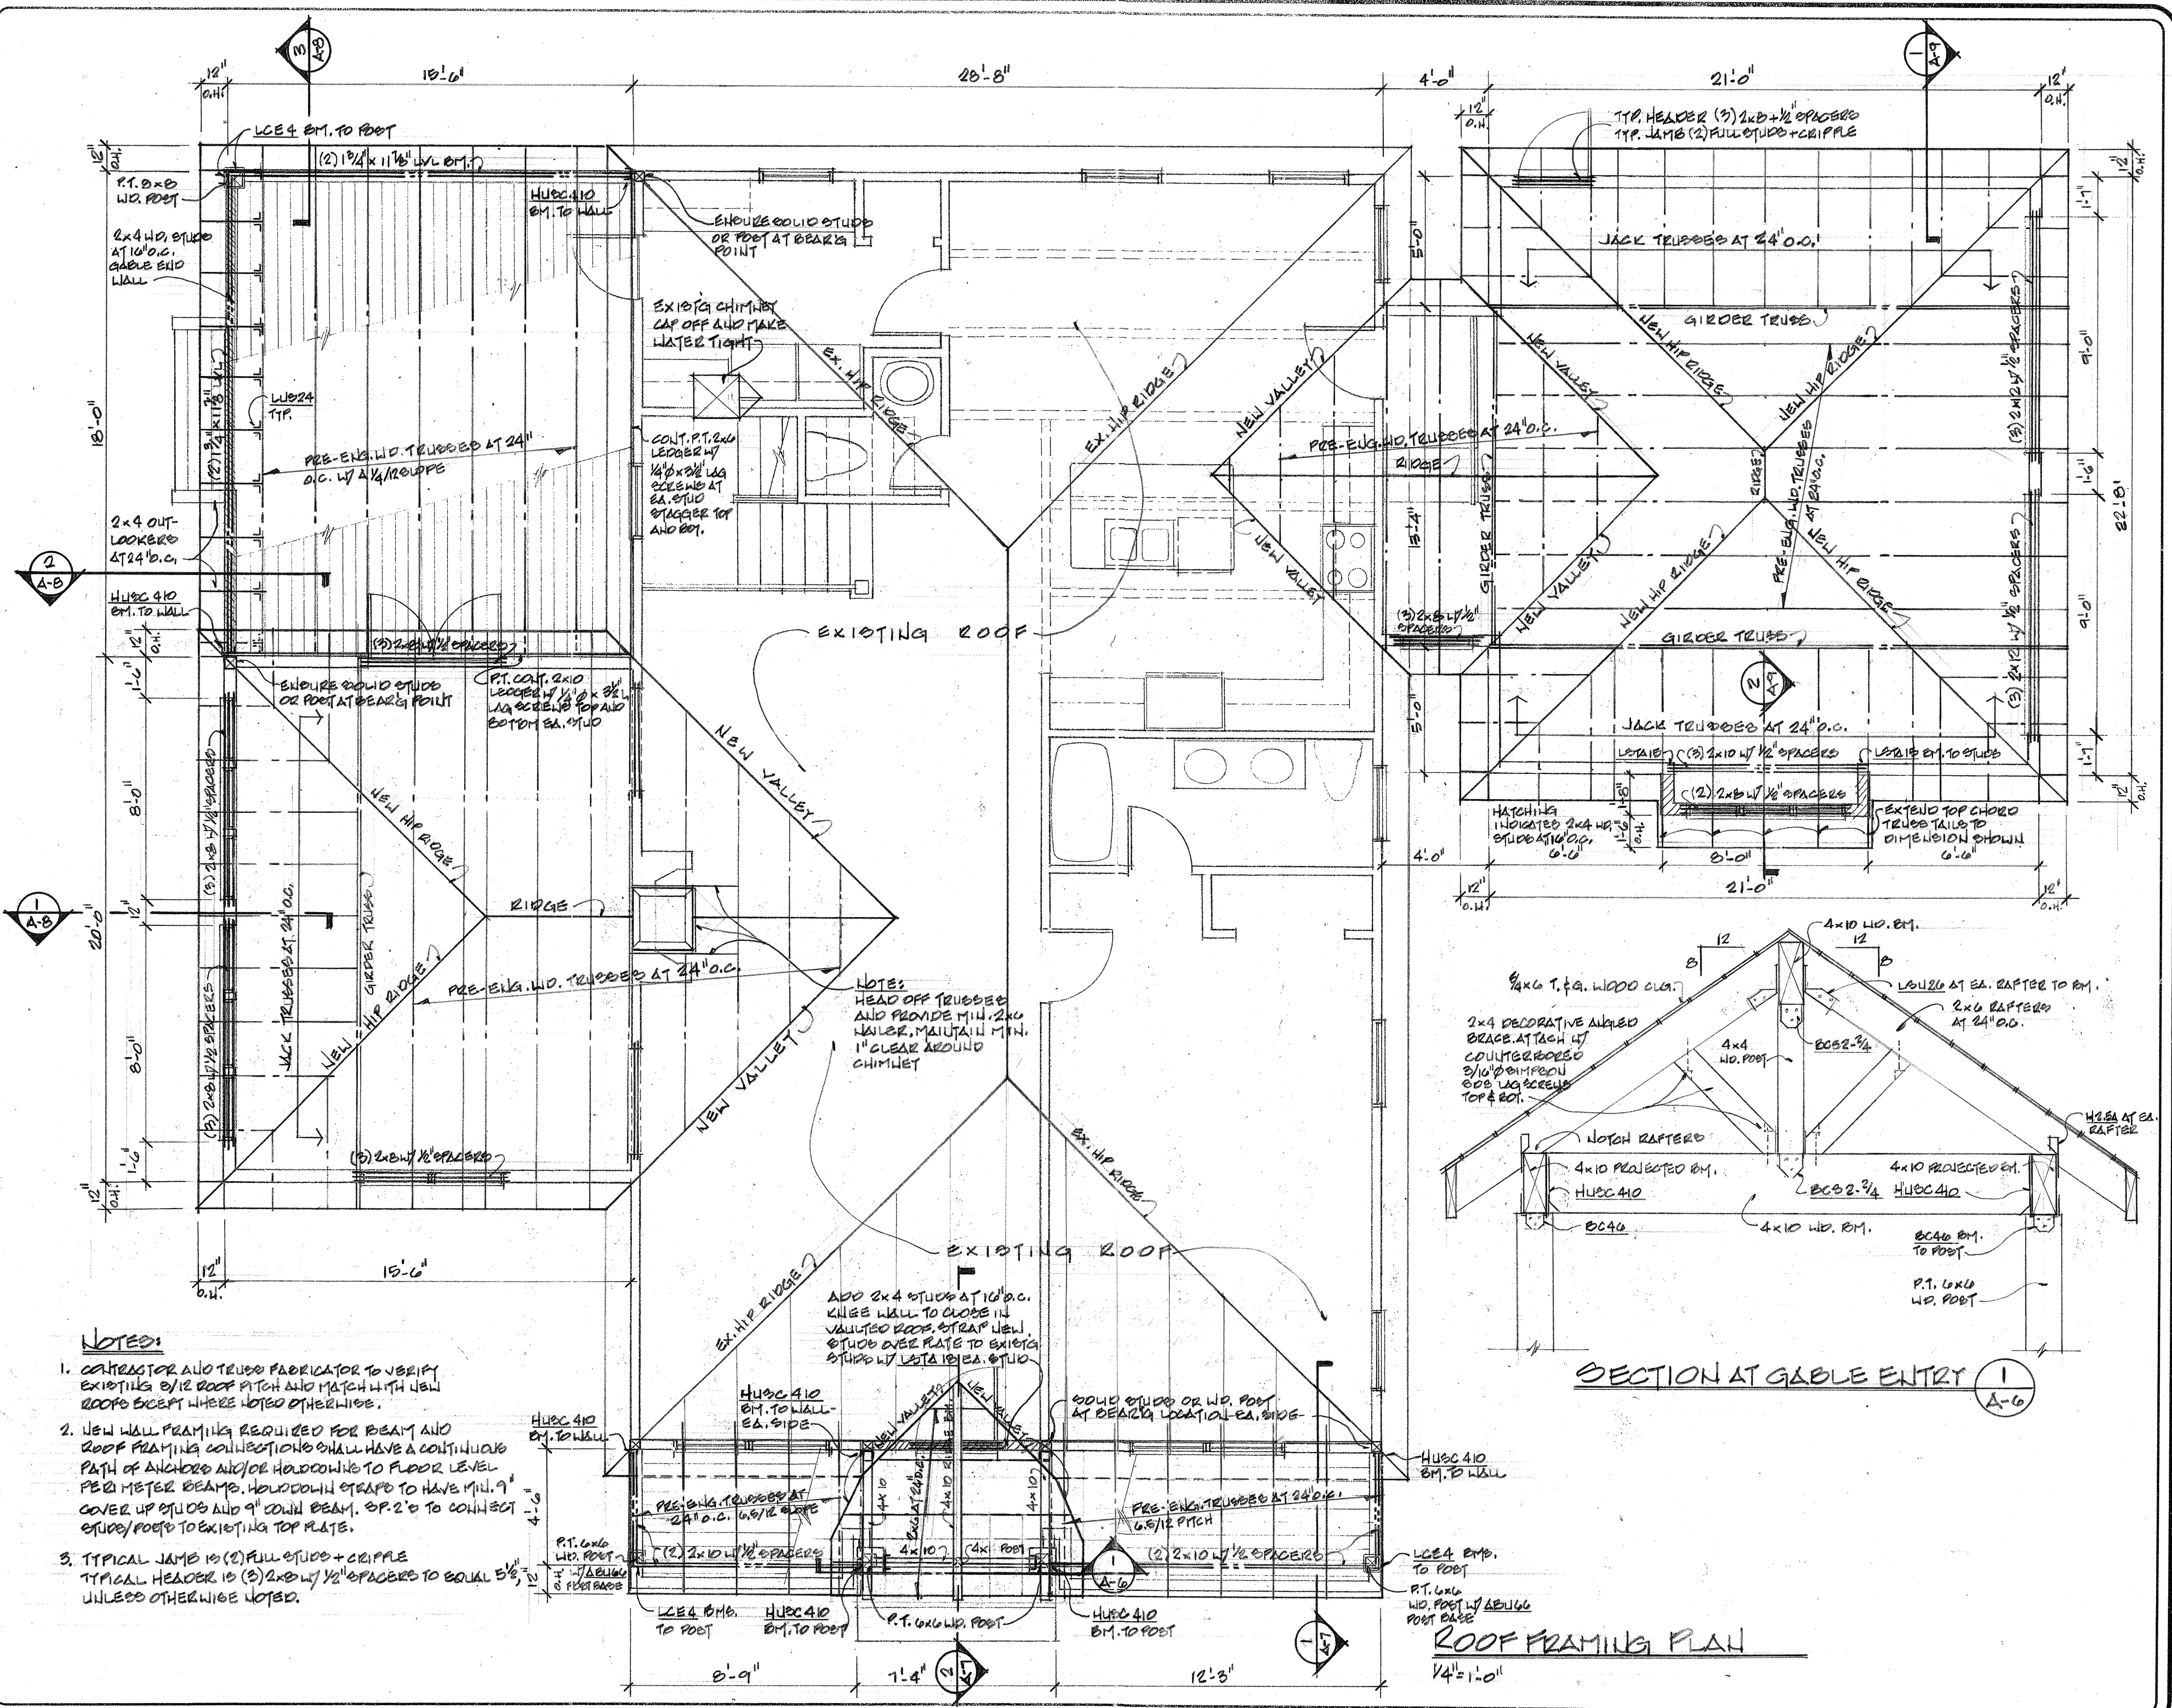

NOTES:

1. CONTRACTOR AND TRUSS FABRICATOR TO VERIFY EXISTING 5/12 ROOF PITCH AND MATCH WITH NEW ROOF EXCEPT WHERE NOTED OTHERWISE.
2. NEW WALL FRAMING REQUIRED FOR BEAM AND ROOF FRAMING CONNECTIONS SHALL HAVE A CONTINUOUS PATH OF ANCHORS AND/OR HOLD-DOWNS TO FLOOR LEVEL PER MEET BEAMS. HOLD-DOWN STRAPS TO HAVE MIN. 9" COVER UP STUDS AND 9" COLLAR BEAM. OR 2" TO CONNECT STUDS/POSTS TO EXISTING TOP PLATE.
3. TYPICAL JAMB IS (2) FULL STUDS + CRIPPLE. TYPICAL HEADER IS (2) 2x6 W/ 1/2" SPACERS TO EQUAL 5 1/2". UNLESS OTHERWISE NOTED.

NOTES:
HEAD OFF TRUSSES AND PROVIDE MIN. 2x4 WAIVER, MAINTAIN MIN. 1" CLEAR AROUND CHIMNEY



ADD 2x4 STUDS AT 10" O.C. KNEE WALL TO CLOSE IN VALUED ROOF. STRAP NEW STUDS OVER PLATE TO EXISTG STUDS W/ LETA 1/2" EA. STUD

SECTION AT GABLE ENTRY

REVISIONS	DATE

BARRY P. ULLMANN
ARCHITECT, LLC
 615 S. MISSOURI AVE., SUITE B
 CLEARWATER, FLORIDA, 33756
 727-441-4405
 barryullmann@aol.com

ADDITION TO AND REMODEL OF
THE IRWIN RESIDENCE
 1400 ORANGE AVE
 BELLEAIR FL





JOB No.
 201857
 DRAWN BY:
 UP
 CHECKED BY:
 MP
 DATE:
 10/22/18
 SHEET No.

A-6
 OF 10


REVISIONS	DATE

BARRY P. ULLMANN
ARCHITECT, LLC
 615 S. MISSOURI AVE., SUITE B
 CLEARWATER, FLORIDA, 33756
 727-441-4405
 barryullmann@aol.com


ADDITION TO AND REMODELING OF
THE IRWIN RESIDENCE
 1400 ORANGE AVE.
 BELLEAIR, FL




JOB No.
 201857
 DRAWN BY:
 LE
 CHECKED BY:
 [Signature]
 DATE:
 10/22/18
 SHEET No.
 A-7

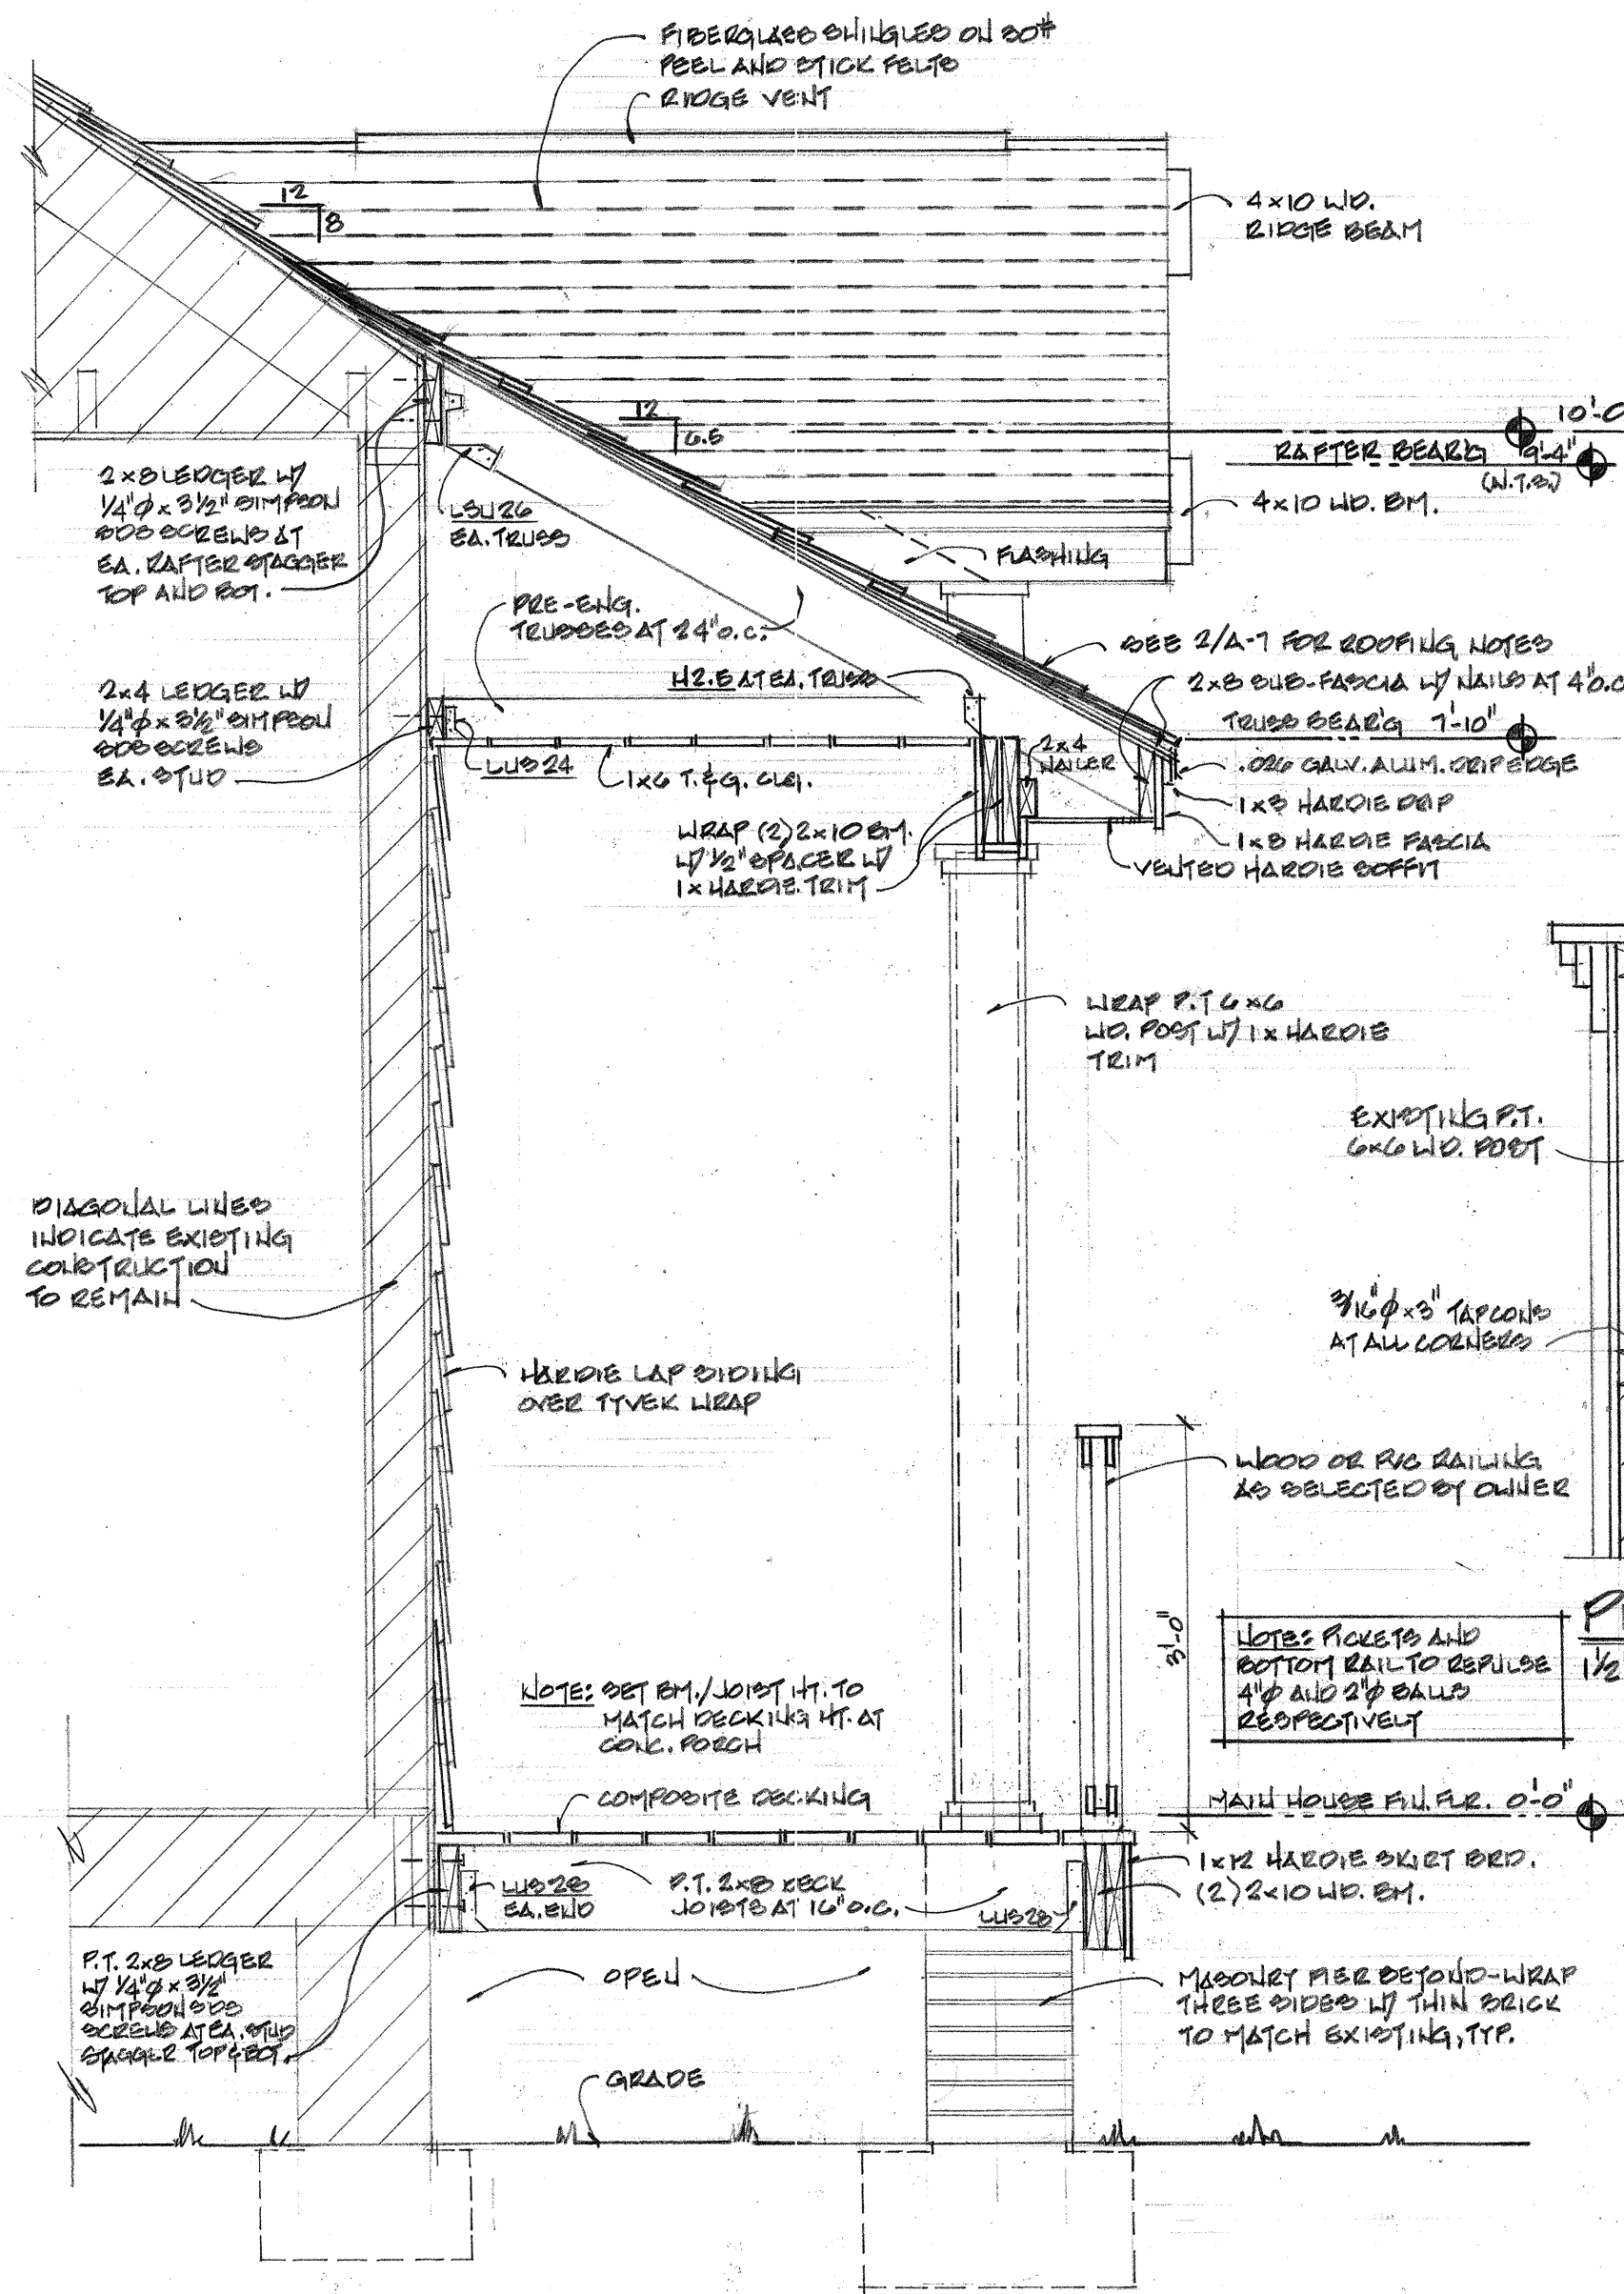

SECTION 1
 3/4" = 1'-0" (A-7)

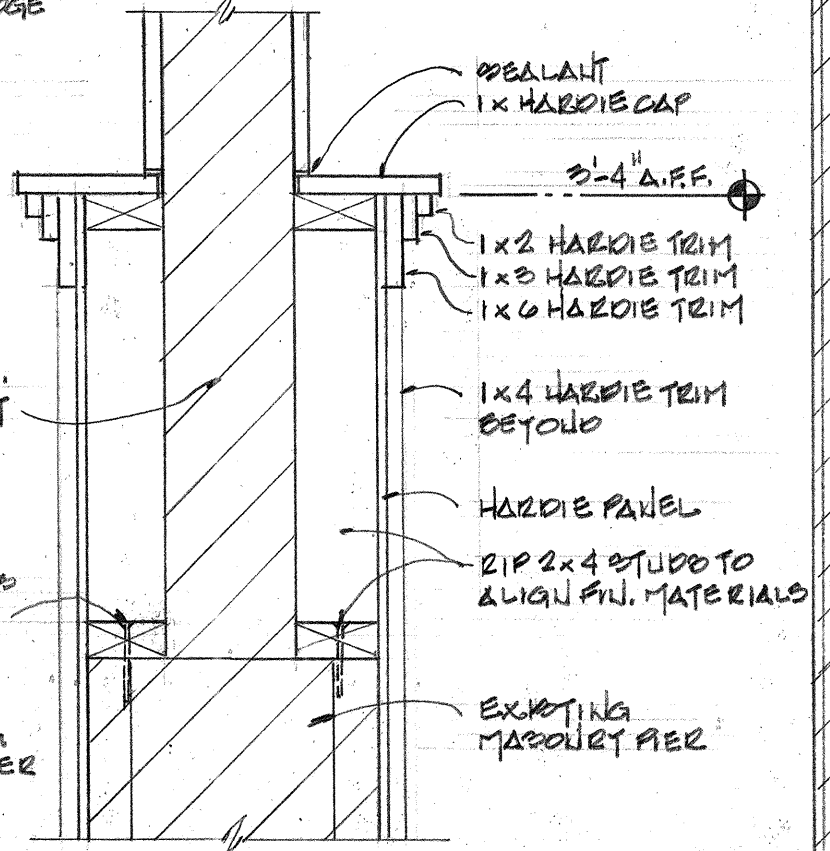

PER DETAIL 3
 1/2" = 1'-0" (A-7)

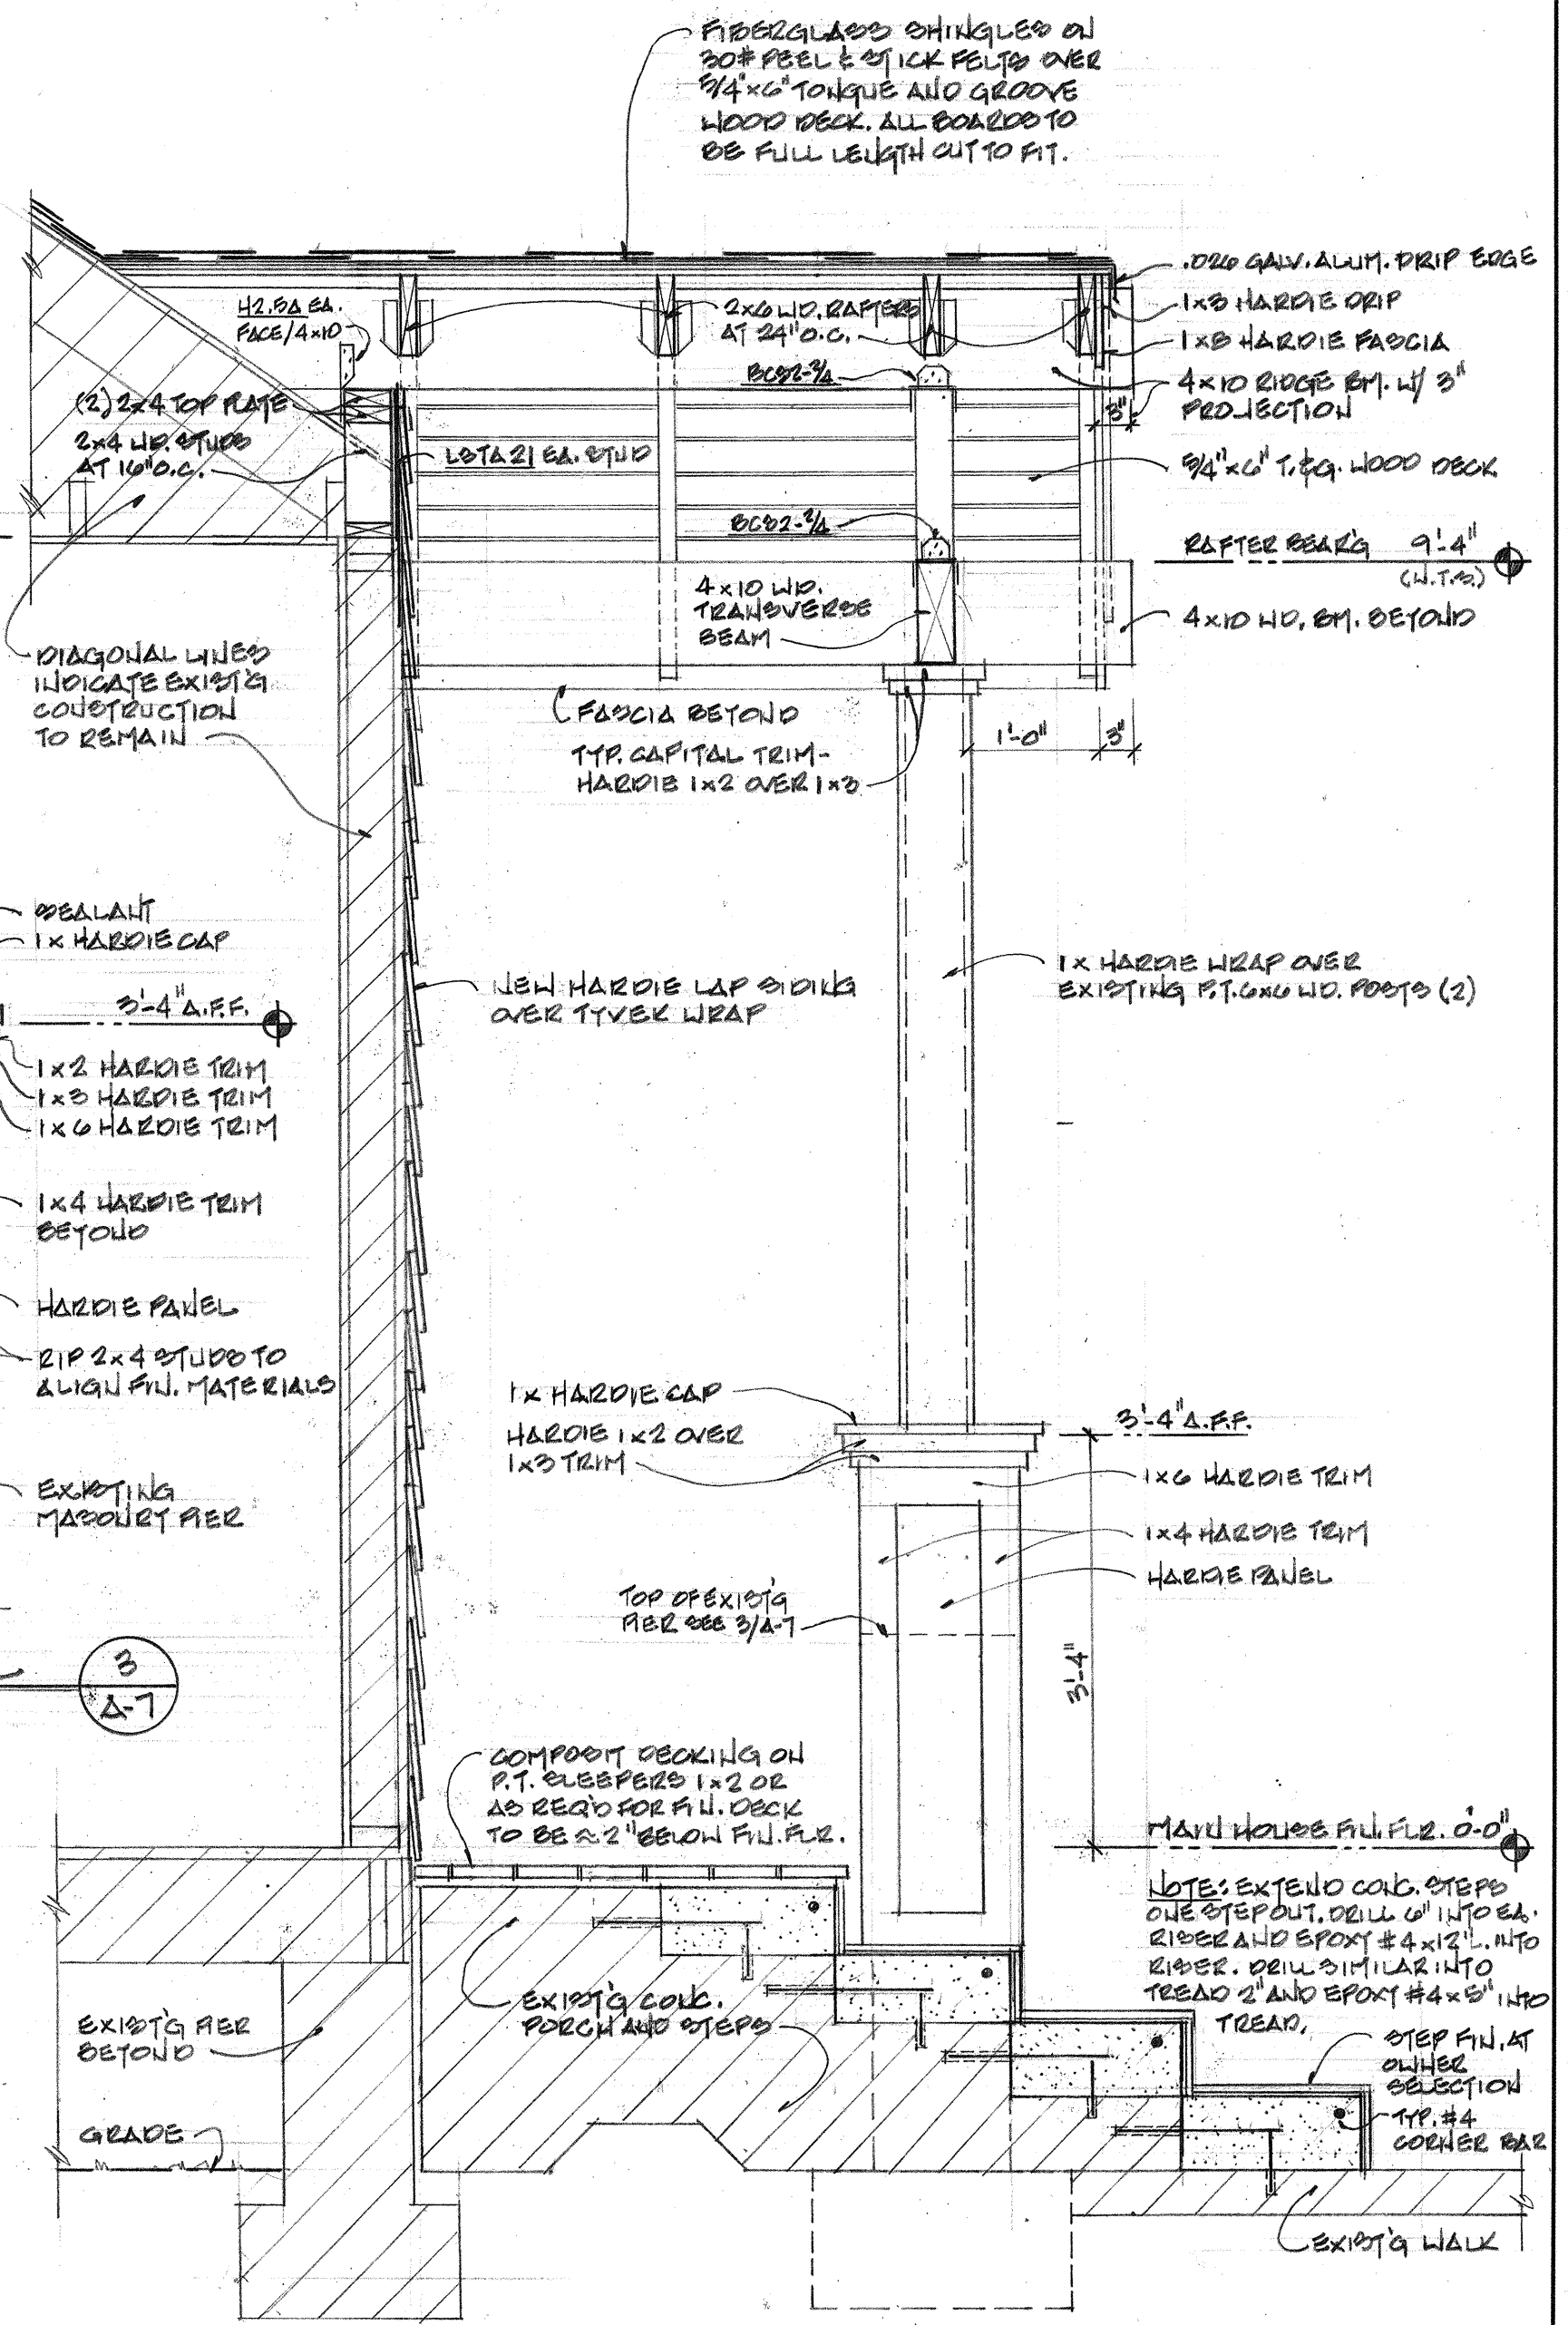


SECTION 2
 3/4" = 1'-0" (A-7)

REVISIONS	DATE



BARRY P. ULLMANN ARCHITECT, LLC
 6115 S. MISSOURI AVE., SUITE B CLEARWATER, FLORIDA 33756
 727-441-4405
 barryullmann@aol.com

ADDITION TO AND RE-MODELING OF
THE IRWIN RESIDENCE
 1460 ORANGE AVE.
 BELLEVILLE, FL



JOB No. 201807
 DRAWN BY: [Signature]
 CHECKED BY: [Signature]
 DATE: 10/22/18
 SHEET No.



A-B
 OF 10

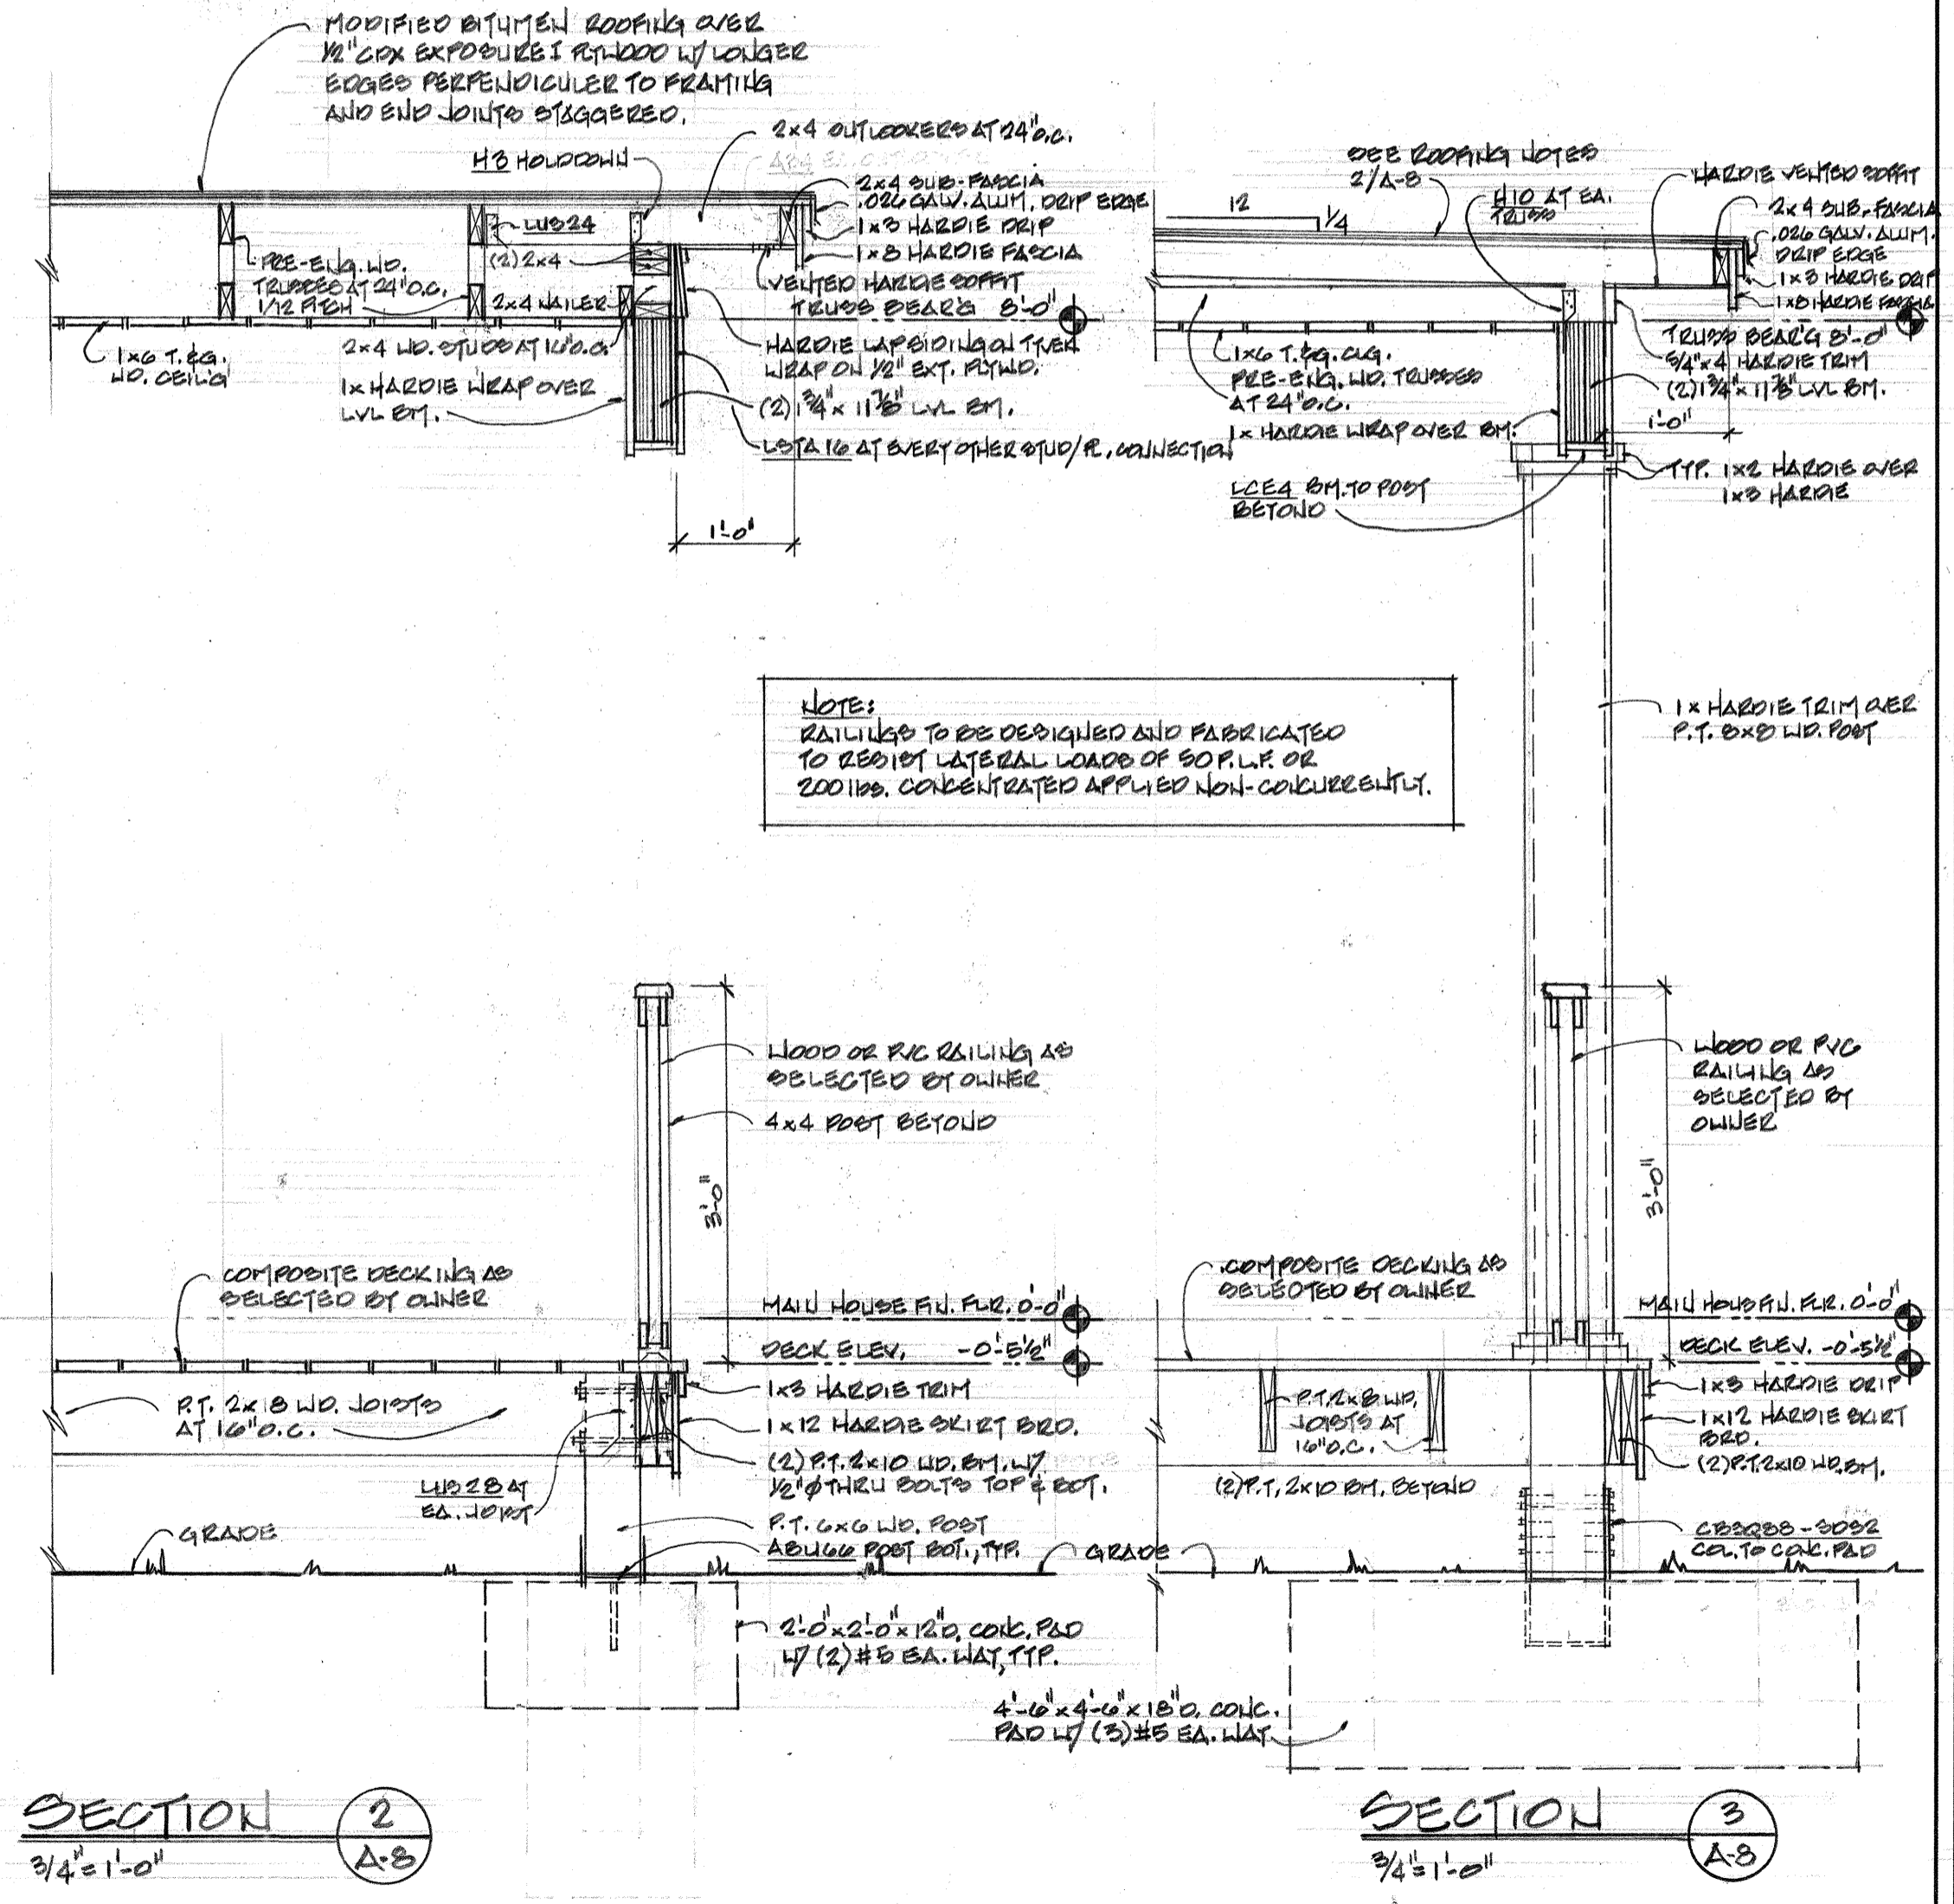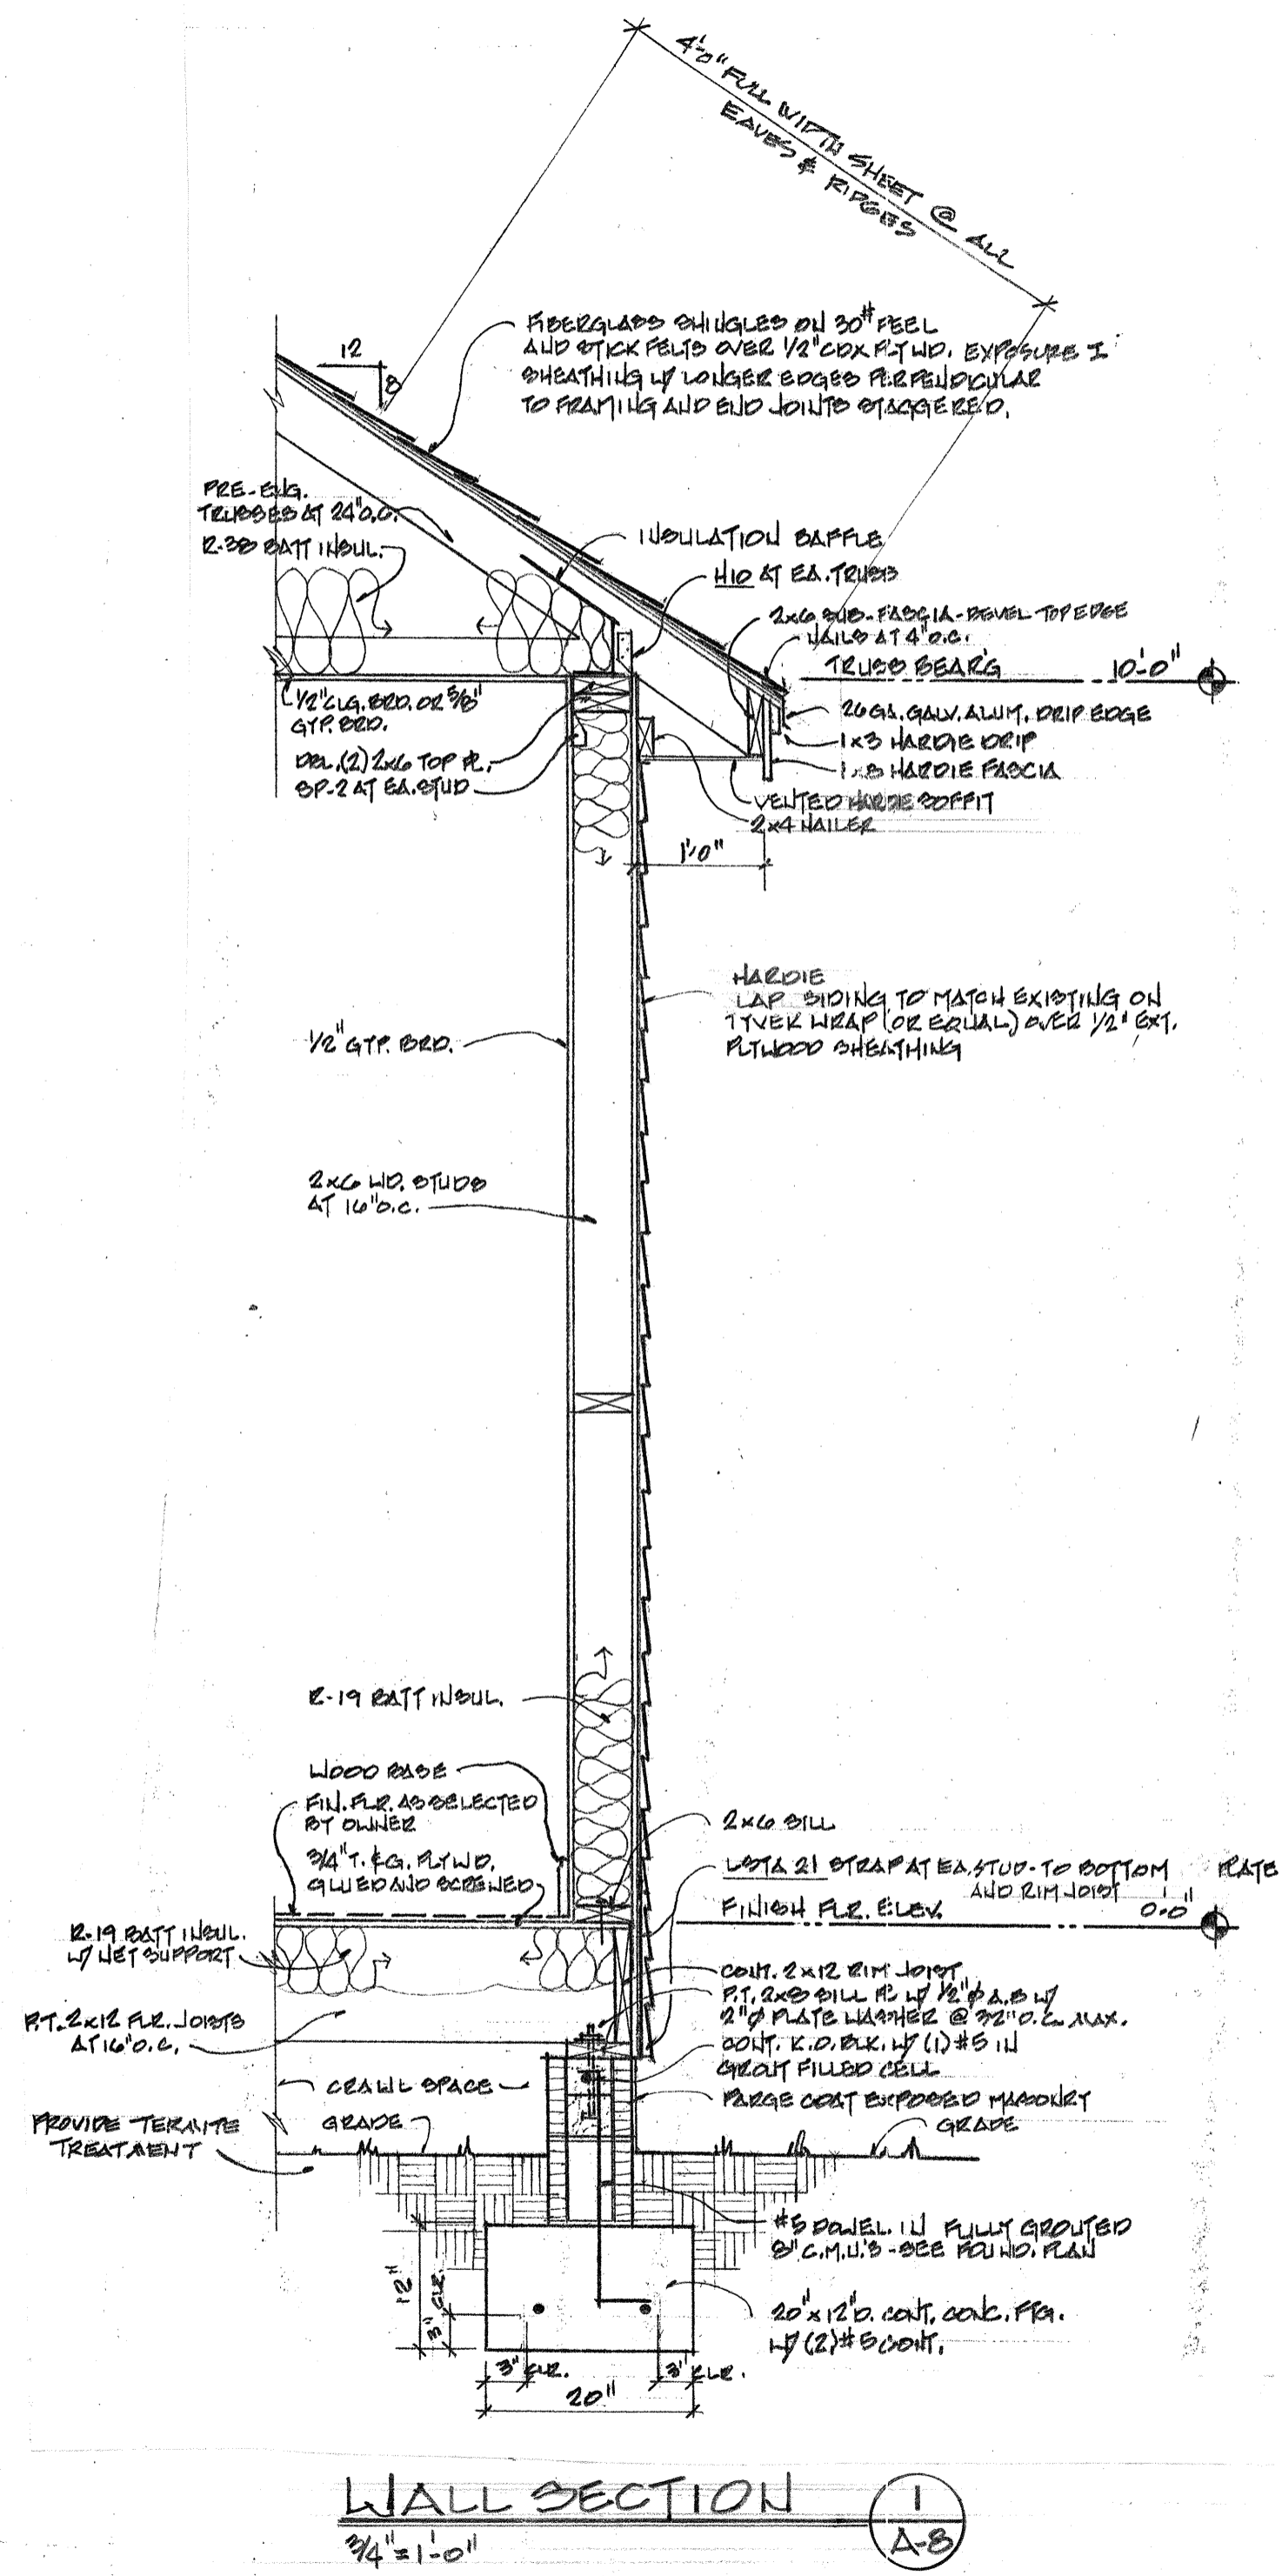





REVISIONS	DATE


BARRY P. ULLMANN ARCHITECT, LLC
 5155 MISSOURI BLVD., SUITE B CLEARWATER, FLORIDA, 33756
 727-441-4405
 barryullmann@aol.com

ADDITION TO AND REMODEL OF THE IRWIN RESIDENCE
 1440 ORANGE AVE., BELLEVILLE, IL



JOB No. 2012051
 DRAWN BY: [Signature]
 CHECKED BY: [Signature]
 DATE: 10/22/18
 SHEET No. A-9

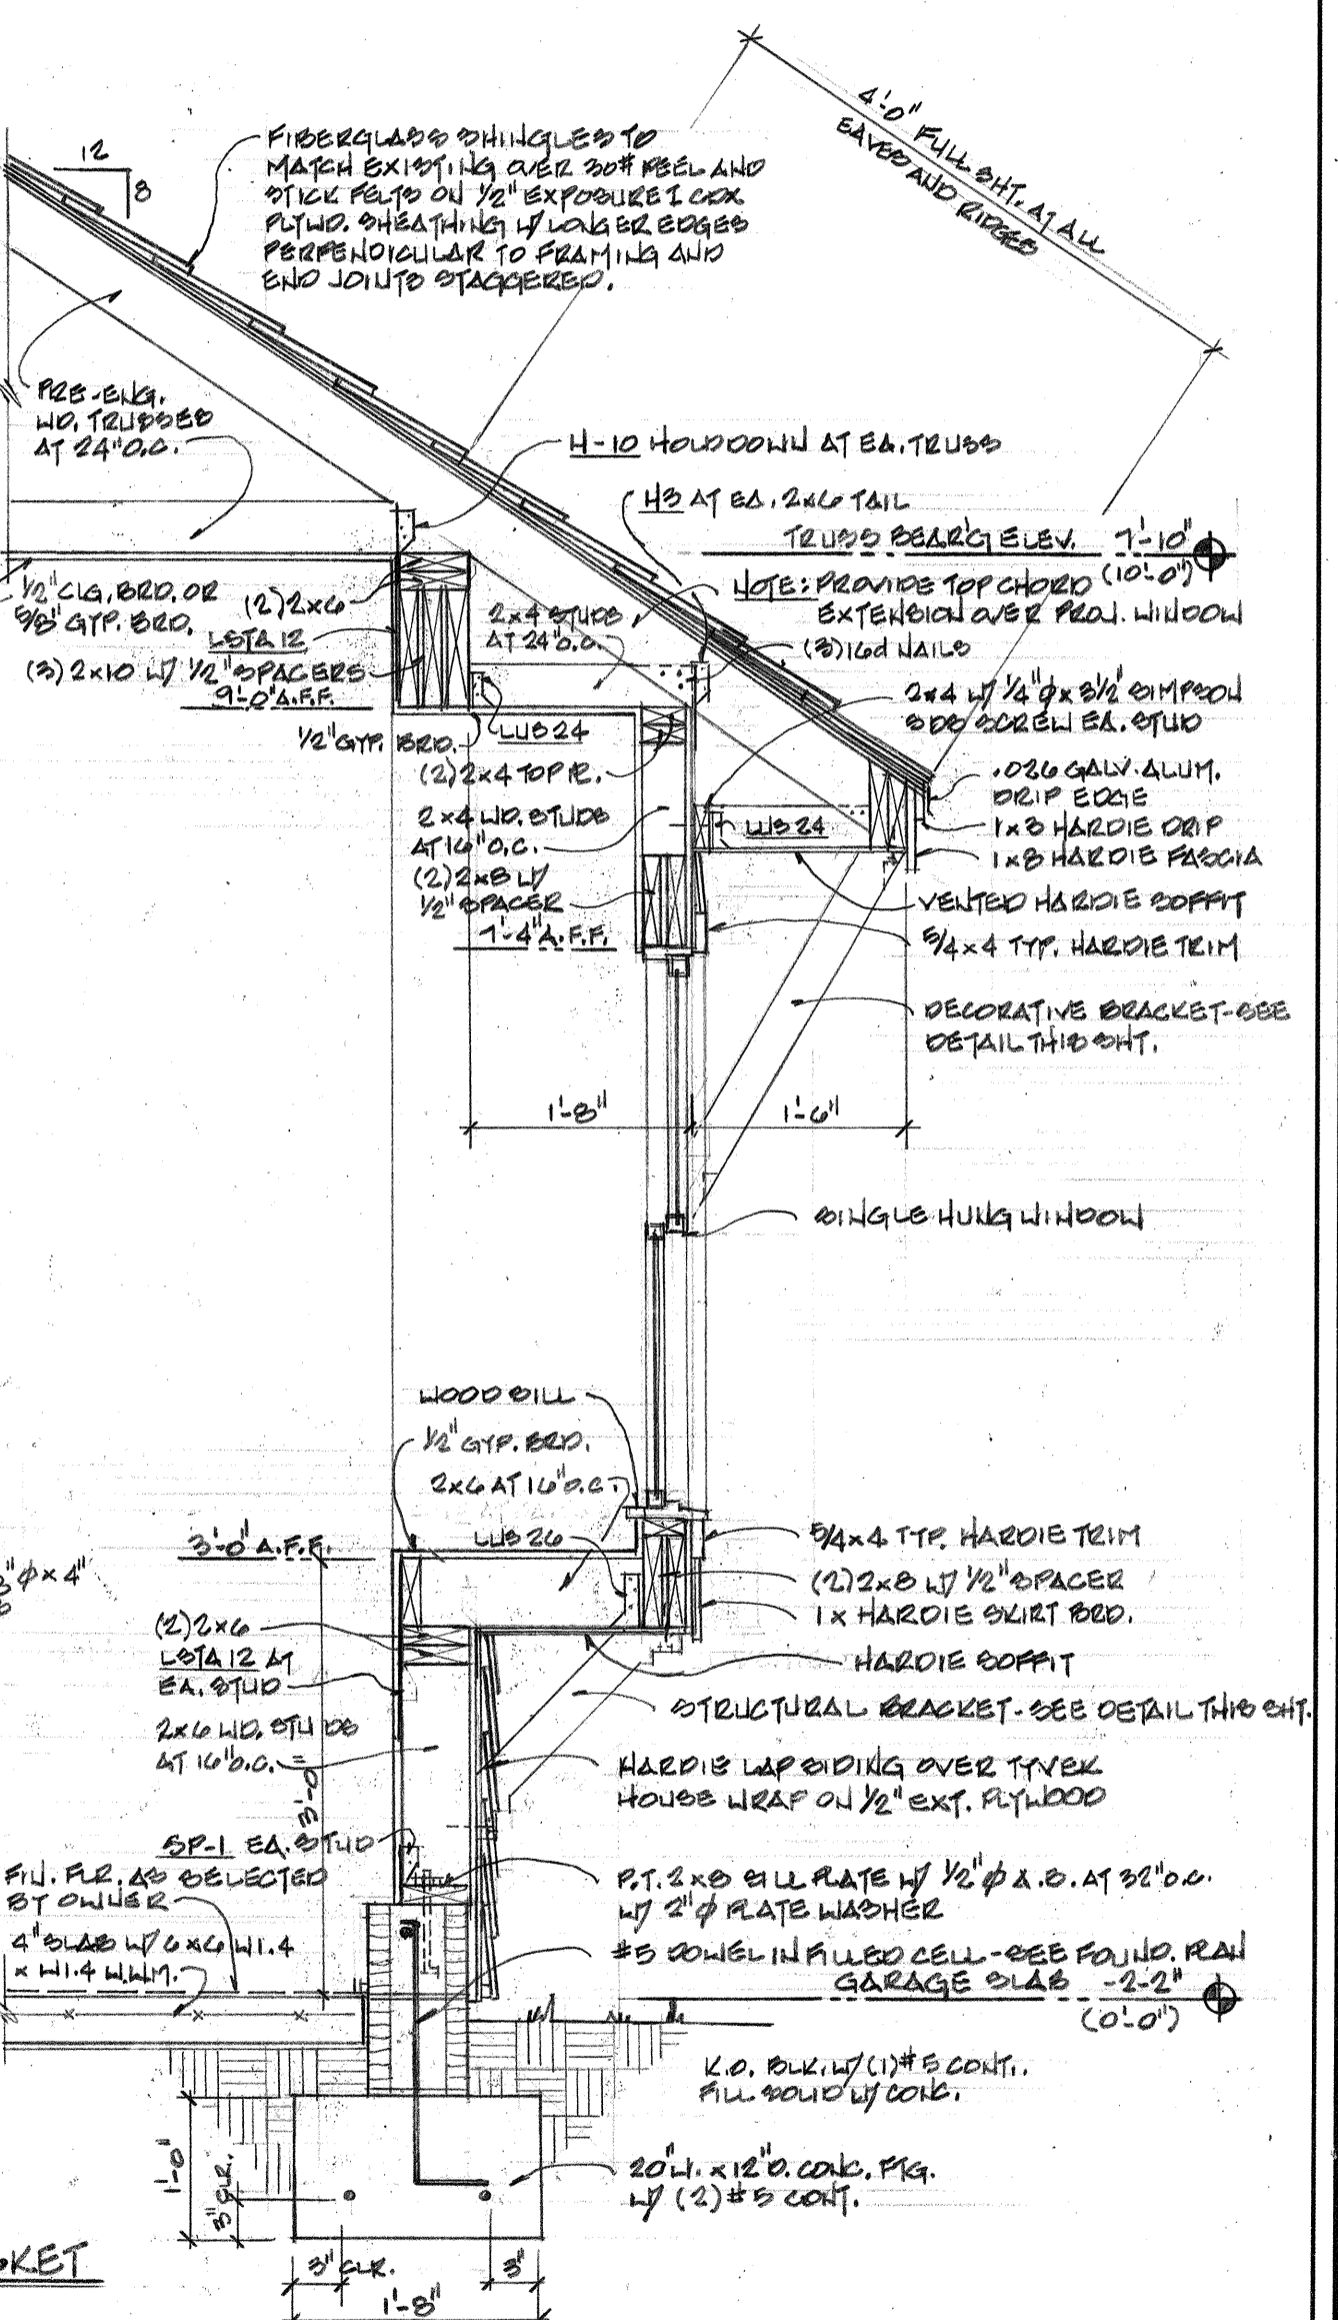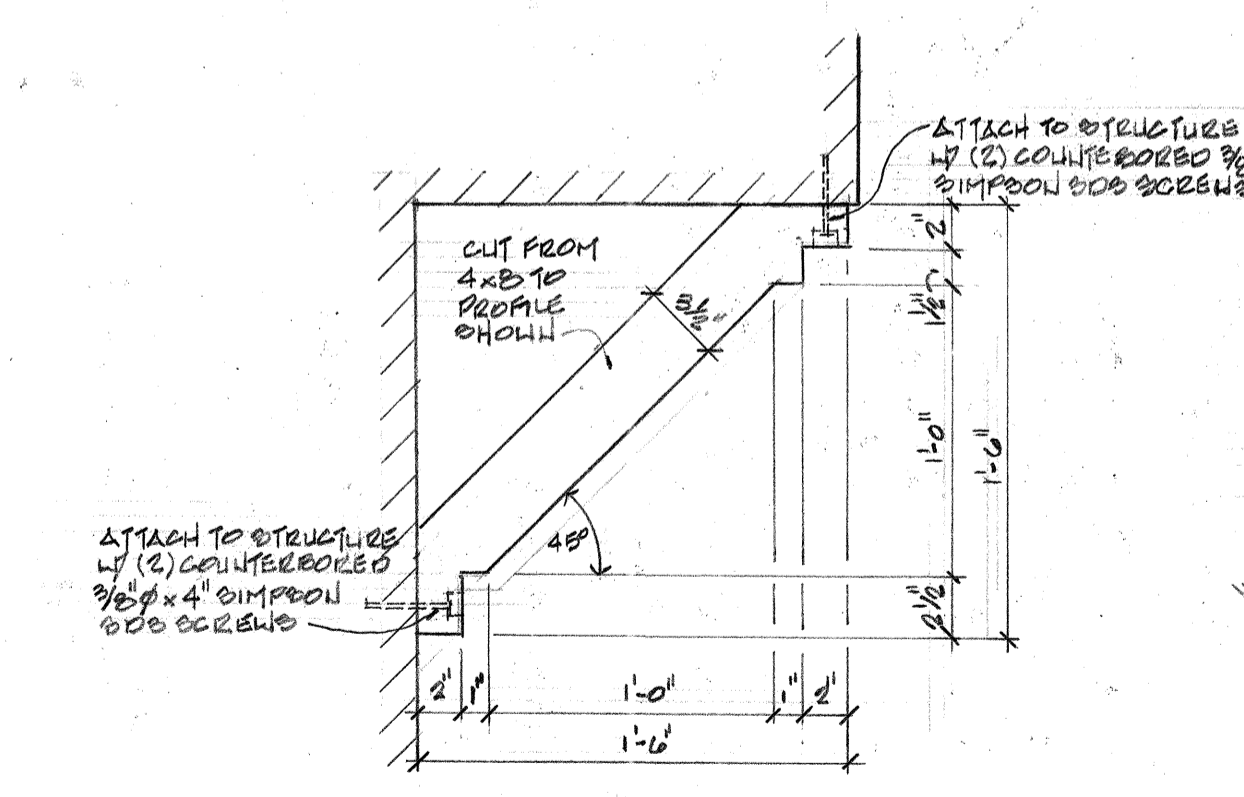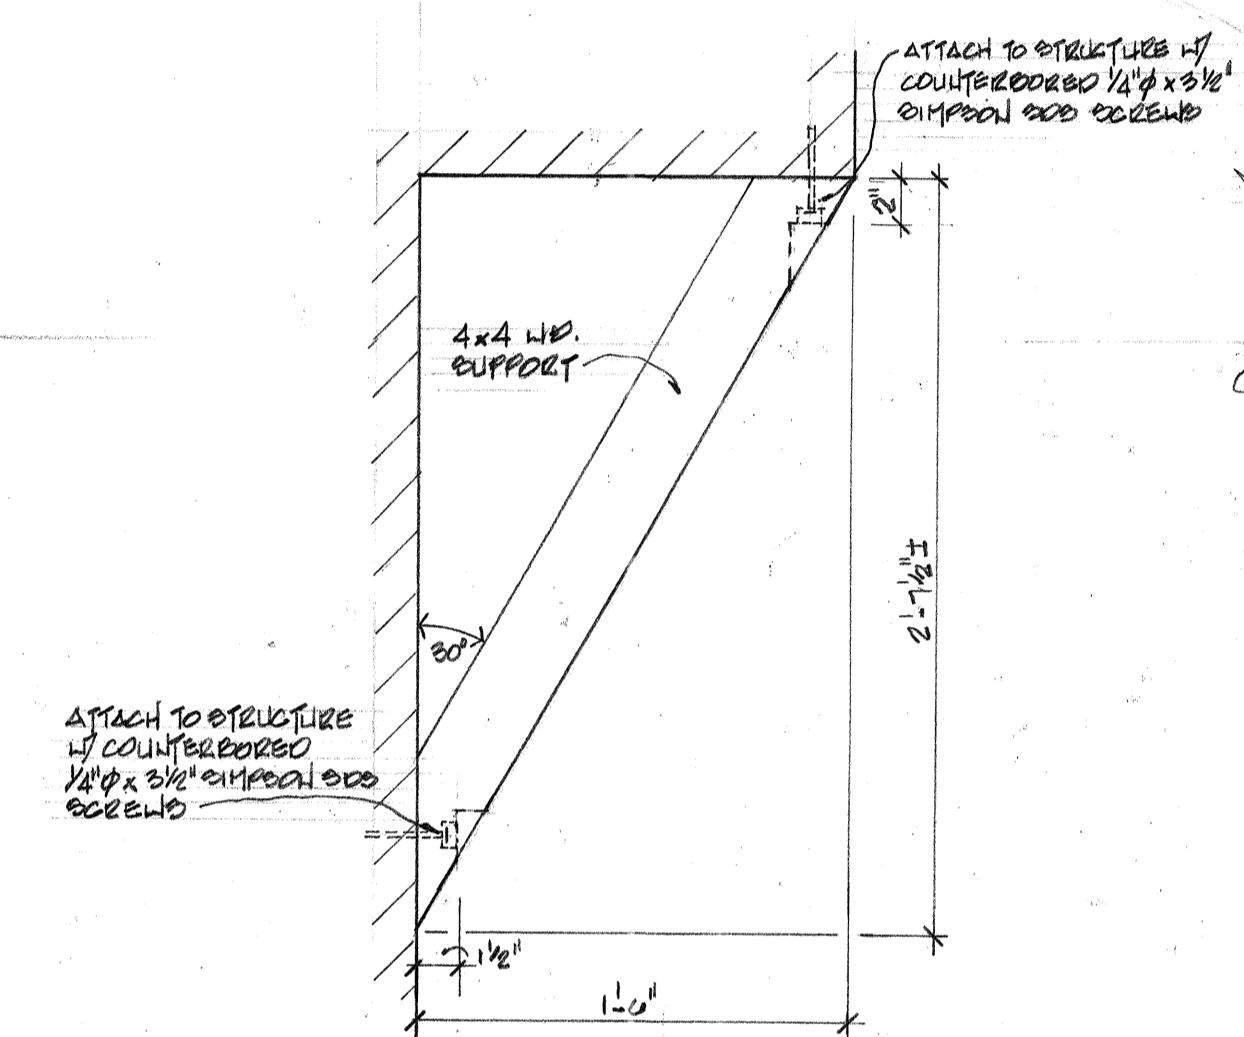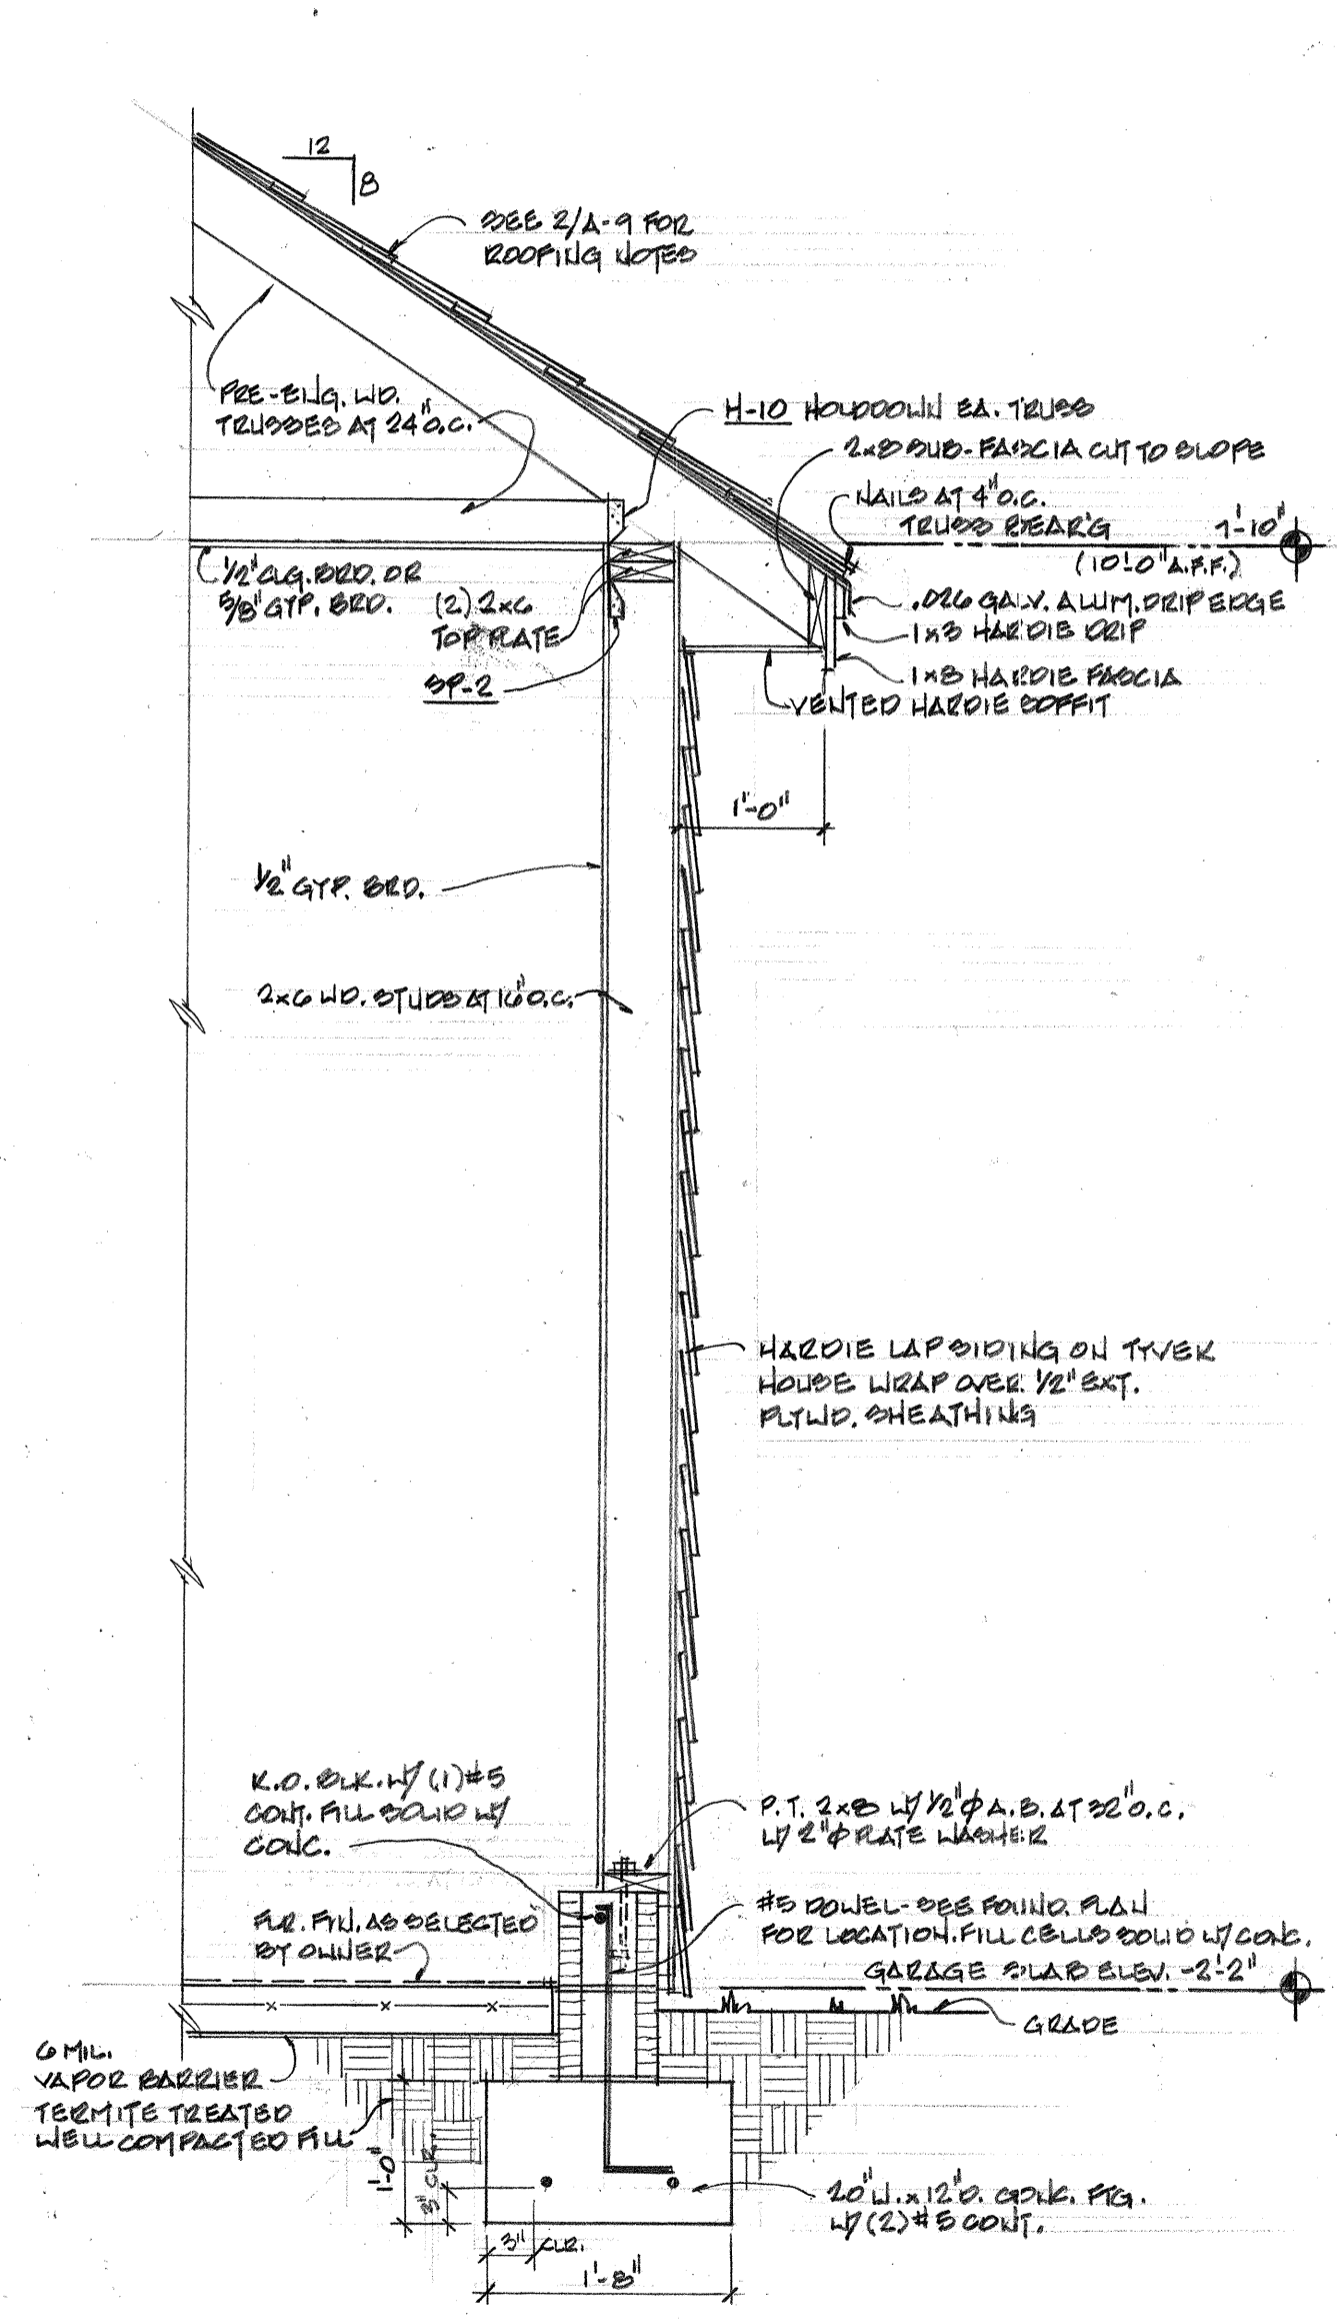

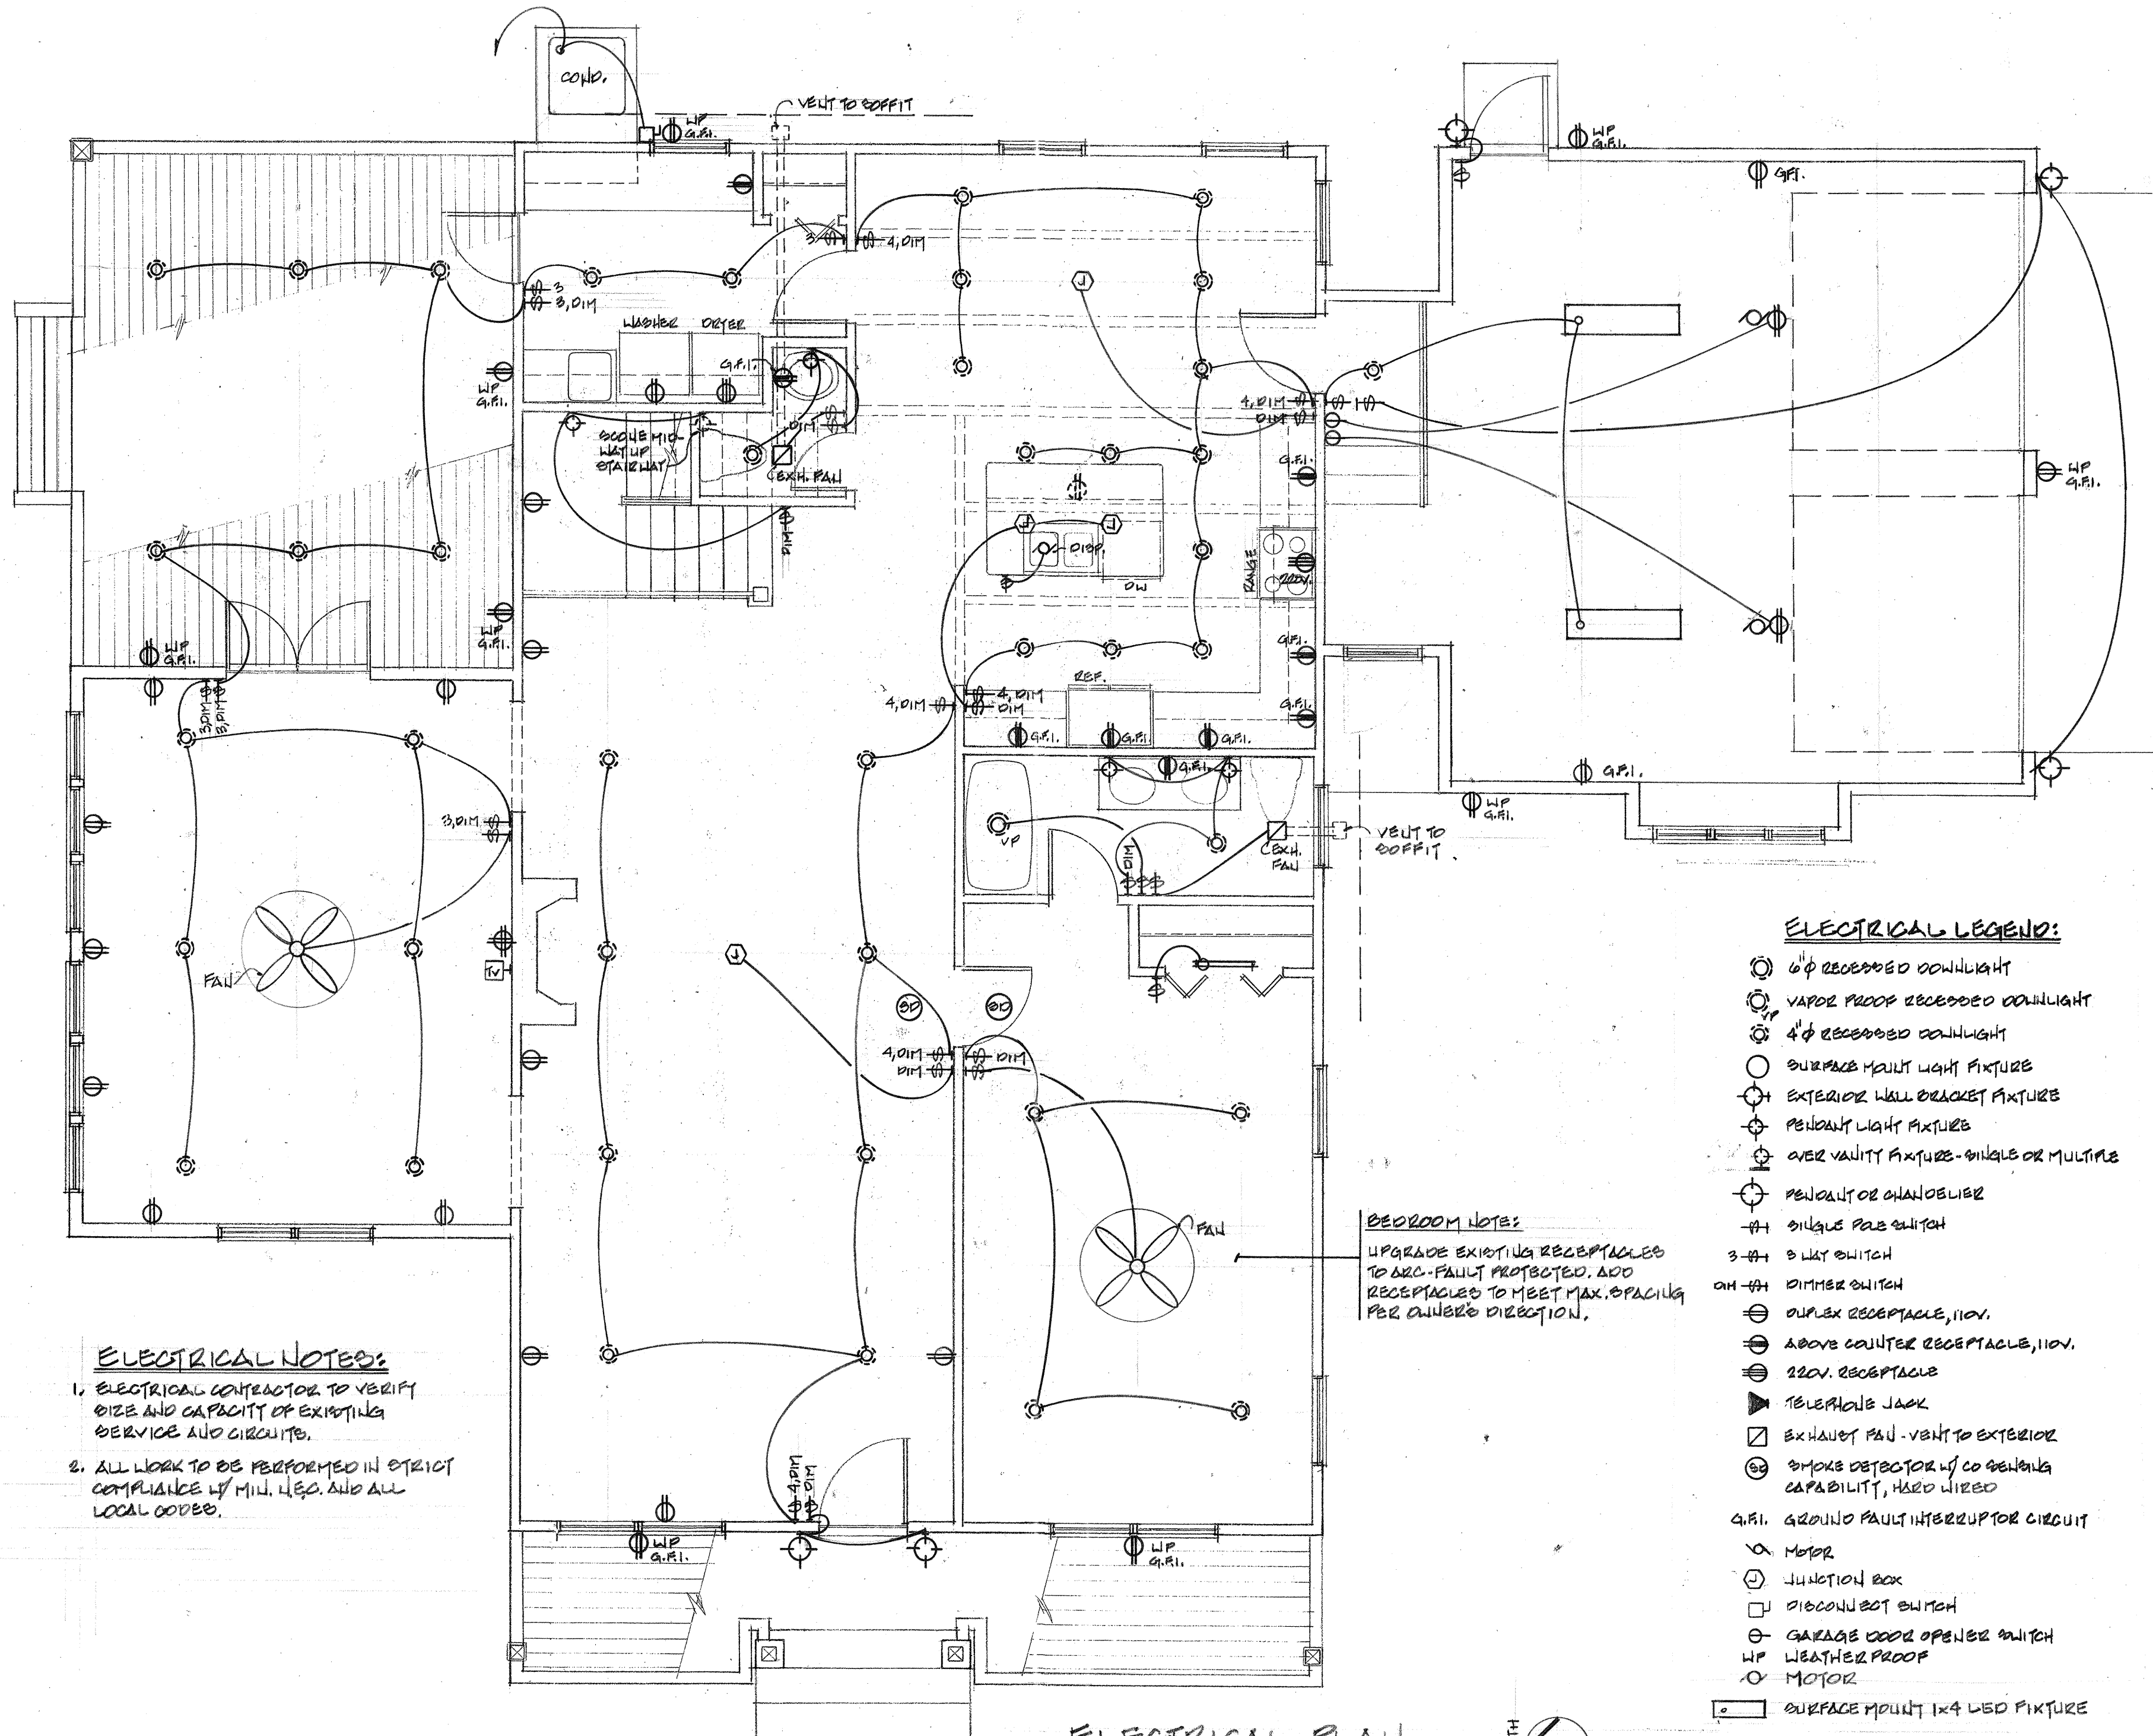

ELECTRICAL NOTES:

1. ELECTRICAL CONTRACTOR TO VERIFY SIZE AND CAPACITY OF EXISTING SERVICE AND CIRCUITS.
2. ALL WORK TO BE PERFORMED IN STRICT COMPLIANCE W/ MIN. U.S.C. AND ALL LOCAL CODES.

BEDROOM NOTES:

UPGRADE EXISTING RECEPTACLES TO GFCI-FAULT PROTECTED. ADD RECEPTACLES TO MEET MAX. SPACING PER OWNER'S DIRECTION.

- ELECTRICAL LEGEND:**
- 6"φ RECESSED DOWNLIGHT
 - VAPOR PROOF RECESSED DOWNLIGHT
 - 4"φ RECESSED DOWNLIGHT
 - SURFACE MOUNT LIGHT FIXTURE
 - EXTERIOR WALL BRACKET FIXTURE
 - PENDANT LIGHT FIXTURE
 - OVER VOLTAGE FIXTURE - SINGLE OR MULTIPLE
 - PENDANT OR CHANDELIER
 - SINGLE POLE SWITCH
 - 3-WAY SWITCH
 - DIMMER SWITCH
 - DUPLEX RECEPTACLE, 110V.
 - ABOVE COUNTER RECEPTACLE, 110V.
 - 220V. RECEPTACLE
 - TELEPHONE JACK
 - EXHAUST FAN - VENT TO EXTERIOR
 - SMOKE DETECTOR W/ CO SENSING CAPABILITY, HARD WIRED
 - G.F.I. GROUND FAULT INTERRUPTOR CIRCUIT
 - MOTOR
 - JUNCTION BOX
 - DISCONNECT SWITCH
 - GARAGE DOOR OPENER SWITCH
 - WEATHER PROOF
 - MOTOR
 - SURFACE MOUNT 1x4 LED FIXTURE



ELECTRICAL PLAN
1/4" = 1'-0"



REVISIONS	DATE

BARRY P ULLMANN
ARCHITECT, LLC
615 S. MISSOURI AVE., SUITE B
CLEARWATER, FLORIDA, 33756
727-441-4405
barryullmann@aol.com

ADDITION TO AND REVISIONS OF
THE IRWIN RESIDENCE
1400 ORANGE AVE.
BELLVALE, FL



JOB No.
101001
DRAWN BY:
LD
CHECKED BY:
NPU
DATE:
10/22/10
SHEET No.
11-1